

Model:

Serial Number:

Year of manufacture:

Test carried out by

On:

Reference:

NOTE: The VWART accuracy is in the range +/-2°C

	HIGH TEMP	LOW TEMP
	VWART °C	VWART °C
DHW		
Keep-warm		
Space heating		
Overall with keep warm		

Pressure test		
No HIU damage		

Dynamic DHW operation	2a	
DHW not exceed 65°C		

Low flow test at BESA flow rate of 0.02l/s	3a	3b
DHW not exceed 65°C		
DHW temperature at set point +/- 3°C		

Low flow test at manufacturer declared flow rate	3c	3d
Declared minimum flow rate (l/sec)		
Not exceed 65°C		
DHW temperature at set point +/- 3°C		

Keep-warm test	4a	4b
Standby heat consumption - average (Watts)		
Standby electricity consumption - average (Watts)		
Total HIU heat loss (DH + electrical input) (Watts)		
Standby flow rate (the average flow rate) (l/hr)		

DHW Response time test	5a	5b
DHW response time (Seconds)		
Peak electrical heat during test (Watts)		
Output		
DHW temperature not exceed 65°C for more than 10 secs		
DHW reaches 45°C with 15 secs		

Scaling risk assessment as defined in 2.26	If any of the factors below occur then the risk of scaling of the DHW PHE in hard water areas increases		
HIU has a TMV or TRV on the DHW			
Test	2a	3a	3c
t32 above 60°C for more than 5 secs			
t12 exceeds 55°C at any point of the test			
Test	4a		4b
t12 exceeds 50°C at any time			




Photo of HIU being tested with the cover off.




Photo of HIU being tested with the cover on.




Photo of Manufacturers label and serial number.

COMPONENT DATA AND DOCUMENTATION

[illegible]

Schematic diagram and drawing showing the structure and arrangement of the HIU with dimensions and weight		
Technical specification for electronic components including version of software		
Installation guide		
Commissioning guide		
Operation guide with a function description/ description of operations and care instructions as suited to the intended user category		
Declaration of Conformity for CE-marked HIUs		
Full parameter list for electronically controlled HIUs		

HIU Marking	Comment	Info present
Model name and type no.		
Serial no.		

HIU MANUFACTURERS' DECLARED INFORMATION (TO BE COMPLETED BY THE MANUFACTURER)

HIU Model	
Part No.	
Software version	
Test Date:	
Test No.	

DIMENSIONAL INFORMATION	
Dimensions with casing (HxDxW) (mm)	
Primary connections top/bottom	
Secondary HTG connections top/bottom	
Secondary BCW/DHW connections top/bottom	
Connection sizes Prim/Sec DHW/Sec HTG (mm)	
Empty weight kg** (Kg)	
Operating weight kg** (Kg)	

ELECTRICAL INFORMATION	
Power supply (230V 1 phase)	230V 1~
Maximum power (Watts)	
Standby power demand (Watts)	

HYDRAULIC INFORMATION	
Maximum primary pressure (Bar g)	
Maximum primary temperature (°C)	
Primary water volume (l)	
Maximum secondary DHW pressure (Bar g)	
Maximum secondary DHW temperature (°C)	
Secondary DHW water volume (l)	
Maximum secondary HTG pressure (Bar g)	
Maximum secondary HTG temperature (°C)	
Primary operating DP range min/max (kPa)	

DECLARED MAXIMUM PERFORMANCE LT TEST CONDITIONS	
DHW	
Maximum DHW production at 70°C (kW)	
Primary flow temperature (°C)	70
Primary return temperature (°C)	
Primary flow (m3/h)	
Primary ΔP^* (kPa)	
Secondary in/out temperature (°C)	10/55
Secondary ΔP (bar)	
HTG	
Maximum HTG production (kW)	
Primary flow temperature (°C)	70
Primary return temperature (°C)	
Primary ΔP^* (bar)	
Secondary in/out temperature (°C)	40/60
Secondary available DP at the output of HIU	

DECLARED MAXIMUM PERFORMANCE LT TEST CONDITIONS	
DHW	
Maximum DHW production at 60°C (kW)	
Primary flow temperature (°C)	60
Primary return temperature (°C)	
Primary flow (m³/h)	
Primary ΔP^* (kPa)	
Secondary in/out temperature (°C)	10/50
Secondary ΔP (bar)	
HTG	
Maximum HTG production (kW)	
Primary flow temperature (°C)	60
Primary return temperature (°C)	
Primary ΔP^* (bar)	
Secondary in/out temperature (°C)	35/45
Secondary available DP at the output of the HIU (kPa)	
HIU P&ID supplied by manufacturer with a legend for the components	

*DP pressure not to include HM. Designers must add HM pressure drop.

** Including HIU, casing and wall hung bracket

The information included in this page is for the specific model of HIU detailed in this test report. It is additional information voluntarily provided by the manufacturer who is solely accountable for the details submitted.

MANUFACTURERS' DECLARATION

This is to confirm that the information supplied by
accurate representation of the product listed on the BESA HIU Register.

relates to the specific HIU tested and is an

Signed



Position

Company

COMMENTS/HISTORY

BESA HIU TEST REPORT

BOSCH Greenstar HIU E

Client: BOSCH Greenstar HIU E

Project Number: E4616 Report Issue: 2

24 January 2022

Prepared By:



Simon Broxham - Project Engineer

Approved By:



Josh Welburn – Project Engineering Manager



THIS PAGE IS INTENTIONALLY LEFT BLANK

DISCLAIMER

This report is confidential to the client named on the front cover.

This report may be stored, transmitted, or reproduced in full by the named client, however if the report is to be placed in the public domain or used for publicity / promotional purposes please inform a director of Enertek International Ltd.

The report must not be reproduced in part, edited, abridged or any extracts used for any purpose whatsoever without written permission from a director of Enertek International Ltd.

The client remains responsible for any data supplied by the client for use in this report. If this data could affect the test results this will be noted in the report.

Any test results contained in this report apply only to the specific sample(s) tested as described in the report.

This report does not imply or indicate any element of commercial approval, recommendation, or promotion by Enertek International Ltd.

BESA SUMMARY SHEET

This test summary, downloaded from the BESA website, indicates that the HIU listed below has been tested against the criteria of the BESA HIU Test Regime.



Model: Greenstar HIU E
 Serial Number: 5570-273-000011-7735600660
 Year of manufacture: 2021
 Test carried out by S.Broxham Enertek Int On: 8/18/21 Reference: E4616

	HIGH TEMP	LOW TEMP
	VWART °C	VWART °C
DHW	23	24
Keep-warm	42	40
Space heating	44	38
Overall with keep warm	33	34

NOTE: The VWART accuracy is in the range +/-2°C

Pressure test		
No HIU damage	Pass	Pass

Dynamic DHW operation	2a	
DHW not exceed 65°C	Pass	Pass

Low flow test at BESA flow rate of 0.02l/s	3a	3b
DHW not exceed 65°C	Pass	Pass
DHW temperature at set point +/- 3°C	n/a	n/a

Low flow test at manufacturer declared flow rate	3c	3d
Declared minimum flow rate (l/sec)	0.03	0.03
Not exceed 65°C	No	n/a
DHW temperature at set point +/- 3°C	Yes	n/a

Keep-warm test	4a	4b
Standby heat consumption - average (Watts)	35	29
Standby electricity consumption - average (Watts)	2.44	2.42
Total HIU heat loss (DH + electrical input) (Watts)		
Standby flow rate (the average flow rate) (l/hr)	3.4	5.2

DHW Response time test	5a	5b
DHW response time (Seconds)	13	15
Peak electrical heat during test (Watts)	5.67	5.83
Output		
DHW temperature not exceed 65°C for more than 10 secs	Pass	Pass
DHW reaches 45°C with 15 secs	Pass	Pass

Scaling risk assessment as defined in 2.26	If any of the factors below occur then the risk of scaling of the DHW PHE in hard water areas increases		
HIU has a TMV or TRV on the DHW	No		
Test	2a	3a	3c
t32 above 60°C for more than 5 secs	No	No	No
t12 exceeds 55°C at any point of the test	No	No	No
Test	4a		4b
t12 exceeds 50°C at any time	No		No

CONTENTS

1	BRIEF	7
2	DEFINITIONS.....	8
3	TEST OBJECT	9
3.1	Appliance Details.....	9
3.2	Appliance Design Pressures	9
3.3	Appliance Design Temperatures	9
4	TEST METHOD.....	10
4.1	Installation of Appliance	10
4.2	Test Regime	10
4.3	Measurement & Uncertainties.....	10
5	TEST RESULTS	15
5.1	Test 0 – Pressure Test	15
5.2	Test 1a to 1f – Space Heating 1-4 kW at 70 and 60°C	15
5.3	Test 2a – DHW Dynamic Tapping at 70 °C.....	16
5.4	Test 2b – DHW Dynamic Tapping at 60 °C	16
5.5	Test 3a & 3c – Low Flow DHW at 70 °C.....	16
5.6	Test 3b & 3d – Low Flow DHW at 60 °C	17
5.7	Test 4a – Keep-Warm at 70 °C	17
5.8	Test 4b – Keep-Warm at 60 °C	18
5.9	Test 5a – DHW Response Time at 70 °C.....	18
5.10	Test 5b – DHW Response Time at 60 °C.....	18
5.11	Overall Scaling Risk Assessment.....	19
5.12	VWART Calculations	20
6	CONCLUSIONS	21
7	APPENDIX A.....	22
7.1	Key Metric Plots	22
7.2	Key Metric and VWART Summary	39
8	APPENDIX B	42
8.1	Appliance Documentation.....	42
8.2	Appliance Photographs	43
8.3	Calibrations and Uncertainties.....	46

LIST OF FIGURES

Figure 4.1 – EIL’s HIU Test Rig Schematic	11
Figure 7.1 - Test 1a – Space Heating 1 kW at 70 °C	23
Figure 7.2 - Test 1b – Space Heating 2 kW at 70 °C	24
Figure 7.3 - Test 1c – Space Heating 4 kW at 70 °C	25
Figure 7.4 - Test 1d – Space Heating 1 kW at 60 °C	26
Figure 7.5 - Test 1e – Space Heating 2 kW at 60 °C	27
Figure 7.6 - Test 1f – Space Heating 4 kW at 60 °C	28
Figure 7.7 - Test 2a – DHW only at 70 °C	29
Figure 7.8 - Test 2b – DHW only at 60 °C	30
Figure 7.9 - Test 3a – Low Flow DHW at 70 °C	31
Figure 7.10 - Test 3b – Low Flow DHW at 60 °C	32
Figure 7.11 - Test 3c – Manufacturers Declared Low Flow DHW at 70 °C	33
Figure 7.12 - Test 3d – Manufacturers Declared Low Flow DHW at 60 °C	34
Figure 7.13 - Test 4a – Keep-Warm at 70 °C	35
Figure 7.14 - Test 4b – Keep-Warm at 60 °C	36
Figure 7.15 - Test 5a – DHW Response Time at 70 °C	37
Figure 7.16 - Test 5b – DHW Response Time at 60 °C	38
Figure 8.1 – Photograph of Appliance [Case Fitted]	43
Figure 8.2 – Photograph of Appliance [Case Removed]	44
Figure 8.3 – Appliance Data Label	45

LIST OF TABLES

Table 2.1 – Definitions and Abbreviations	8
Table 3.1 – Appliance Details	9
Table 3.2 – Appliance Design Maximum Pressures	9
Table 3.3 – Appliance Design Maximum Temperatures	9
Table 4.1 – Setup of Tests (Based on BESA Test Regime, Table 1: Test Schedule)	12
Table 4.2 – Test Reporting, (Adapted from BESA Test Regime, Table 5)	13
Table 5.1 - Test Results for Space Heating Tests 1a to 1f	15
Table 5.2 - Overall Scaling Risk Assessment	19
Table 5.3 – High Temperature VWARD Calculations	20
Table 5.4 – Low Temperature VWARD Calculations	20
Table 7.1 - Key Metrics of High Temperature Package	40
Table 7.2 - Key Metrics of Low Temperature Package	41
Table 8.1 – Documentation Supplied	42
Table 8.2 - EIL Equipment Calibration and Uncertainties	46

1 BRIEF

- 1.1.1 Enertek international Limited (EIL), were contracted to receive, install, and commission a production sample of the Greenstar HIU E with Heat Meter.
- 1.1.2 To carry out the work involved to evaluate the performance of Domestic Hot Water (DHW) and Space Heating (SH) in accordance with the BESA UK HIU Test regime Technical Specification, Rev-009 October 2018, a publicly available online Test Regime. This is here-on referred to as the Test Regime throughout this document.
- 1.1.3 To provide a report detailing the tests carried out and generated results in accordance with the Test Regime criteria, including calculations for Volume Weighted Average Return Temperatures (VWART).

2 DEFINITIONS

2.1.1 The following definitions and abbreviations which have been used within this report can be found in table 2.1 below.

Table 2.1 – Definitions and Abbreviations

Symbol	Description	Unit
P_1	Power, Primary Side	kW
P_2	Power, Space Heating Side	kW
P_3	Power, Domestic Hot Water	kW
t_{11}	Temperature, Primary Side Supply Connection	°C
t_{12}	Temperature, Primary Side Return Connection	°C
t_{21}	Temperature, Space Heating Side Return Connection	°C
t_{22}	Temperature, Space Heating System Supply Connection	°C
t_{31}	Temperature, Cold Water Supply	°C
t_{32}	Temperature, Domestic Hot Water Output from HIU	°C
q_1	Volume Flow, Primary Side	L/s
q_2	Volume Flow, Space Heating Side	L/s
q_3	Volume flow, Domestic Hot Water	L/s
Δp_1	Primary Pressure drop across entire HIU Unit	kPa
Δp_2	Pressure Drop, Space Heating System across HIU	kPa
Δp_3	Pressure Drop, Domestic Hot Water across HIU	kPa
$VWART_{DHW}$	DHW Volume Weighted Return Temperature	°C
$VWART_{SH}$	Space Heating Volume Weighted Return Temperature	°C
$VWART_{KWH}$	Keep Warm Volume Weighted Return Temperature	°C
$VWART_{HEAT}$	Annual Volume Weighted Return Temperature for Heating Period	°C
$VWART_{NONHEAT}$	Annual Volume Weighted Return Temperature for Non-Heating	°C
$VWART_{HIU}$	Total Annual Volume Weighted Return Temperature	°C
DHW	Domestic Hot Water	—
HIU	Heat Interface Unit	—
SH	Space Heating	—
TMV	Thermostatic Mixing Valve	—
EIL	Enertek International Limited	—

3 TEST OBJECT

3.1 Appliance Details

- 3.1.1 Details of the Greenstar HIU E appliance are given in Table 3.1. Photograph of the installed appliance is given in Figure 8.2.

Table 3.1 – Appliance Details

Item	Description
Manufacturer	BOSCH Worcester
Model	Greenstar HIU E
Serial Number	5570-273-000011-7735600660
Year of Manufacture	2021
DHW Priority	Yes

3.2 Appliance Design Maximum Pressures

- 3.2.1 The maximum design pressures of the Greenstar HIU E appliance for the primary side and the secondary side for both Space Heating and DHW are given in Table 3.2.

Table 3.2 – Appliance Design Maximum Pressures

Item	Value	Unit
Primary Side	10	Bar
Secondary Side Space Heating	2.5	Bar
Secondary Side DHW	10	Bar

3.3 Appliance Design Maximum Temperatures

- 3.3.1 The maximum design temperatures of the Greenstar HIU E appliance for the primary side and the secondary side for both Space Heating and DHW are given in Table 3.3.

Table 3.3 – Appliance Design Maximum Temperatures

Item	Value	Unit
Primary Side	90	°C
Secondary Side Space Heating	70	°C
Secondary Side DHW	60	°C

4 TEST METHOD

4.1 Installation of Appliance

- 4.1.1 The appliance was installed and commissioned (as received) and as defined in the product literature provided. Testing was carried out without further adjustment other than disabling the internal space heating pump and adjusting the setting of the SH and DHW set points through the user interface on the HIU controller to suit the conditions of the HIU test rig. The HIU rig schematic is given in Figure 4.1.

4.2 Test Regime

- 4.2.1 The testing described in this report was carried out in accordance with the BESA Test Regime. The Test Regime outlines a series of static and dynamic tests to determine the performance of a HIU's DHW and SH functions. The Regime outlines the test method including the reporting of the results, the performance requirements and the VWART calculations.
- 4.2.2 The setup of the BESA tests is reproduced in Table 4.1. The basis of reporting the performance of the HIU from the BESA Test Regime is reproduced in Table 4.2.
- 4.2.3 The Test Regime specifies the testing of two different test temperature packages. The first is the high temperature package, with a district primary supply of 70 °C and the second is the 'low temperature' package, with a district primary supply temperature of 60 °C.
- 4.2.4 As the Greenstar HIU E is suitable for both high and low temperature operation, both test packages were carried out and results recorded within this report.

4.3 Measurement & Uncertainties

- 4.3.1 All measurements and uncertainties adhere to the requirements stipulated in the BESA Test Regime. All measurements were sampled at a rate of 1 Hz for all tests.
- 4.3.2 The BESA uncertainties of measurement requirements are as follows: Differential Pressure, ± 1 kPa; Temperature, ± 0.1 °C; Volume Flow, ± 1.5 %. Note: the time constant for the temperature sensors is less than 1.5 s.
- 4.3.3 EIL's reported uncertainty is based on a standard uncertainty by a coverage factor $K=2$, providing a level of confidence of approximately 95%. The uncertainty evaluation has been carried out in accordance with UKAS requirements. The EIL equipment list and uncertainties are given in Table 8.2, Appendix B.

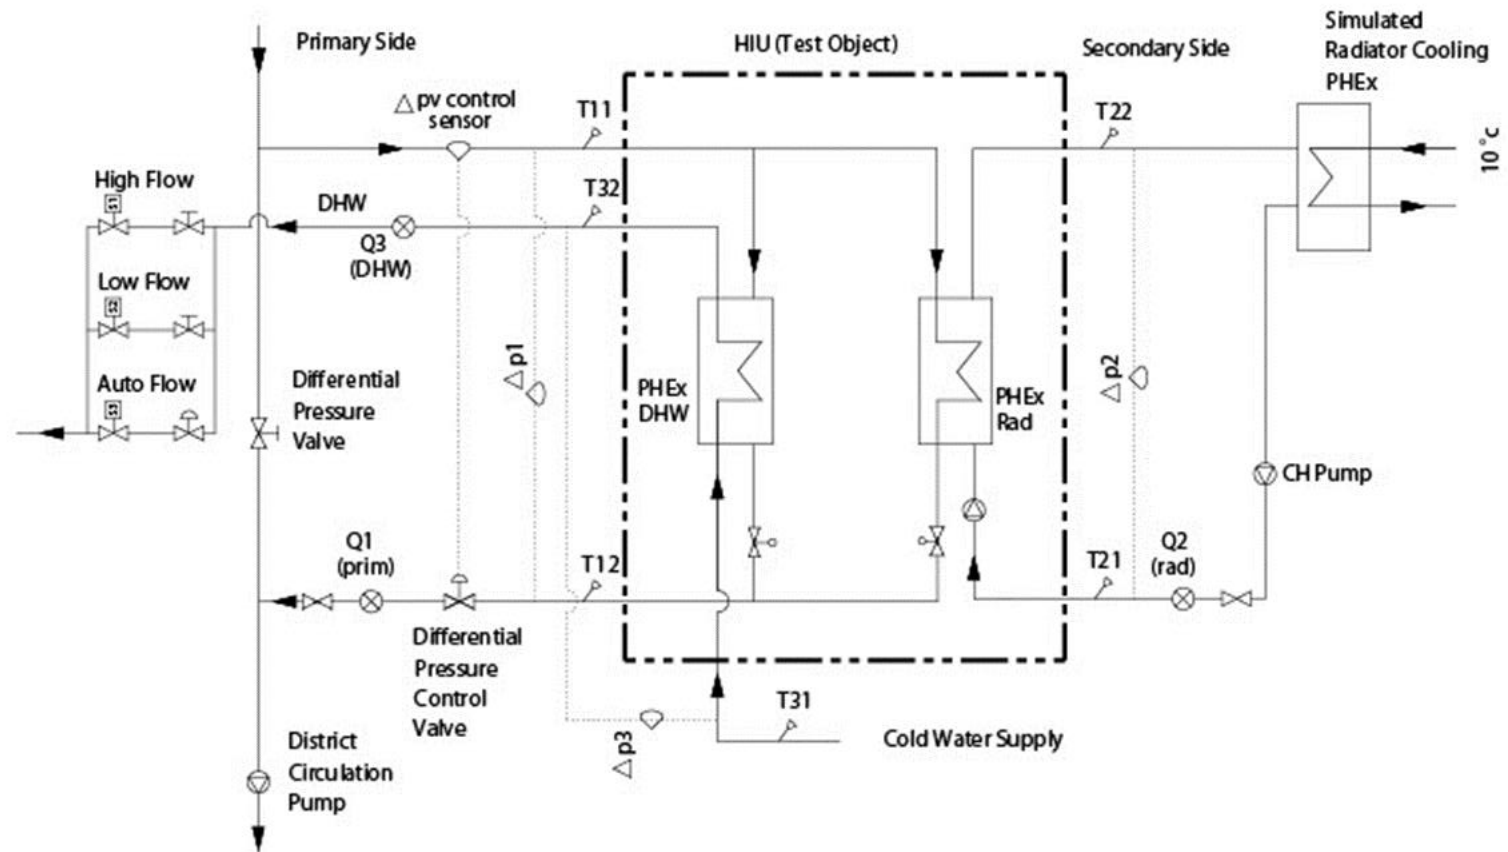


Figure 4.1 – EIL's HIU Test Rig Schematic

Table 4.1 – Setup of Tests (Based on BESA Test Regime, Table 1: Test Schedule)

		District Circuit			Domestic Hot Water			Space Heating		
		Static Pressure	Differential Pressure	Flow Temperature	Temperature Set Point	Flow Rate	Heat Load	Flow Temperature	Return Temperature	Heat Load
<i>Symbol</i>		$[p_1]$	$[\Delta p_1]$	$[t_{11}]$	$[t_{32}]$	$[q_3]$	$[P_3]$	$[t_{22}]$	$[t_{21}]$	$[P_2]$
<i>Units</i>		$[kPa]$	$[kPa]$	$[^{\circ}C]$	$[^{\circ}C]$	$[Ls^{-1}]$	$[kW]$	$[^{\circ}C]$	$[^{\circ}C]$	$[kW]$
Static Tests										
0a	District Pressure Test	1.43 X Claimed Value	-	-	-	-	-	-	-	-
1a	1kW Space Heating	3.0	0.5	70	-	-	-	60	40	1
1b	2kW Space Heating	3.0	0.5	70	-	-	-	60	40	2
1c	4kW Space Heating	3.0	0.5	70	-	-	-	60	40	4
1d	1kW Space Heating	3.0	0.5	60	-	-	-	45	35	1
1e	2kW Space Heating	3.0	0.5	60	-	-	-	45	35	2
1f	4kW Space Heating	3.0	0.5	60	-	-	-	45	35	4
Dynamic Tests										
2a	Dynamic Tapping	3.0	0.5	70	55	See Test Profile	See Test Profile	-	-	-
2b	Dynamic Tapping	3.0	0.5	60	50			-	-	-
3a	Low Flow	3.0	0.5	70	55	0.02	Record Value.	-	-	-
3b	Low Flow	3.0	0.5	60	50	0.02	Record Value.	-	-	-
4a	Keep-Warm	3.0	0.5	70	55	0.00	0	-	-	-
4b	Keep-Warm	3.0	0.5	60	50	0.00	0	-	-	-
5a	DHW Response	3.0	0.5	70	55	0.13	Record Value.	-	-	-
5b	DHW Response	3.0	0.5	60	50	0.13	Record Value.	-	-	-

Table 4.2 – Test Reporting, (Adapted from BESA Test Regime, Table 5)

Test Designation		Reporting
0	District Pressure Test	Pass/Fail as to whether HIU manages pressure test without leaks or damage.
1a	Space Heating 1 kW, 60/40 °C secondary.	t_{11} – Primary flow temperature. t_{12} – Primary return temperature.
1b	Space Heating 2 kW, 60/40 °C Secondary.	Plot of key metrics over duration of test.
1c	Space Heating 4 kW, 60/40 °C Secondary.	Note: Outputs used as input data to ‘High Temperature’ Space Heating Volume Weighted Average Return Temperature calculation.
1d	Space Heating 1 kW, 45/35 °C Secondary.	t_{11} – Primary flow temperature. t_{12} – Primary return temperature.
1e	Space Heating 2 kW, 45/35 °C Secondary.	Plot of key metrics over duration of test.
1f	Space Heating 4 kW, 45/35 °C Secondary.	Note: Outputs used as input data to ‘Low Temperature’ Space Heating Volume Weighted Average Return Temperature calculation.
2a	DHW Only, DH 70 °C Flow, 55 °C DHW.	Pass/Fail on DHW (at t_{32}) exceeding 65.0 °C (to 1 decimal point) for more than 10 consecutive seconds. State the maximum and minimum DHW temperatures over the period of the test when there is a DHW flow. Assessment of scaling risk as per the criteria detailed in 2.26. Note: Outputs used as input data to ‘High Temperature’ Space Heating Volume Weighted Average Return Temperature calculation. Plot t_{32} , t_{31} , q_3 , t_{12} , q_1
2b	DHW Only, DH 60 °C Flow, 50 °C DHW.	State the maximum and minimum DHW temperatures over the period of the test when there is a DHW flow. Note: Outputs used as input data to ‘Low Temperature’ Domestic Hot Water Volume Weighted Average Return Temperature calculation. Plot q_1 , q_3 , dp_1 , dp_3
3a	Low Flow DHW, DH 70 °C Flow, 55 °C DHW.	Pass/Fail on DHW (at t_{32}) exceeding 65.0 °C (1 decimal place) for more than 10 consecutive seconds. Comment on ability to deliver DHW at low flow based on DHW temperature reaching at least 45.0 °C (1 decimal place) at the end of the 180 second period of low flow DHW. Comment on the ability to deliver stable DHW flow temperature (at t_{32}), defined as ability to maintain 55.0 +/- 3.0 °C (1 decimal place) during the last 60 seconds of the test. Maximum temperature achieved and +/- °C variance around 55.0 °C (1 decimal place) to be stated. Plot of key metrics for 60 seconds of 0.13 l/s flow and the subsequent 180 seconds of 0.02 l/s DHW flow. Assessment of scaling risk as per criteria detailed in 2.26.
3b	Low Flow DHW, DH 60 °C Flow, 50 °C DHW.	Comment on the ability to deliver DHW at low flow rate based on DHW temperature reaching at least 45 °C (1 decimal place) at the end of the 180 second period of low flow DHW. Comment on the ability to deliver stable DHW flow temperature (at t_{32}), defined as ability to maintain 50.0 +/- 3 °C (1 decimal place) to be stated. Maximum temperature achieved and +/- °C variance around 50.0 °C (1 decimal place) to be stated. Plot of key metrics for 60 seconds of 0.13 l/s flow and the subsequent 180 seconds of 0.02 l/s DHW flow.

Test Designation		Reporting
4a	Keep-Warm, DH 70 °C Flow, 55 °C DHW.	<p>Assessment of whether valid keep-warm operation, based on 5a response time criteria: Pass/Fail.</p> <p>Comment on HIU keep-warm controls options.</p> <p>Assessment of scaling risk based on duration of temperatures in excess of 55.0 °C (1 decimal place).</p> <p>State average heat load for the duration of the test.</p> <p>State the average primary flow rate for the duration of the test.</p> <p>Note: Outputs used as input data to 'High Temperature' Keep-warm Volume Weighted Average Return Temperature calculation.</p> <p>Plot of key metrics over duration of test.</p>
4b	Keep-Warm, DH 60 °C Flow, 50 °C DHW.	<p>Assessment of whether valid keep-warm operation, based on 5b response time criteria: Pass/Fail.</p> <p>Observation on the operation of the HIU during keep-warm. Comment on HIU keep-warm controls options.</p> <p>Assessment of scaling risk based on extent and duration of temperatures in excess of 55.0 °C (1 decimal place).</p> <p>State average heat load for the duration of the test.</p> <p>State the average primary flowrate for the duration of the test.</p> <p>Note: Outputs used as input data to 'Low Temperature' Keep-warm Volume Weighted Average Return Temperature calculation.</p> <p>Plot of key metrics over duration of test.</p>
5a	DHW Response Time, DH 70 °C Flow, 55 °C DHW.	<p>Pass/Fail on DHW (at t_{32}) exceeding 65.0 °C (1 decimal place) for more than 10 consecutive seconds.</p> <p>State time to achieve 45.0 °C (1 decimal place) and not subsequently drop below 42.0 °C (1 decimal place).</p> <p>Plot t_{32}, t_{31}, t_{12}, q_1 over duration of test.</p>
5b	DHW Response Time, DH 60 °C Flow, 50 °C DHW.	<p>State time to achieve a DHW temperature 45.0 °C (1 decimal place) and not subsequently drop below 42.0 °C (1 decimal place).</p> <p>Comment on stability of DHW temperature.</p> <p>Plot t_{32}, t_{31}, t_{12}, q_1 over duration of test.</p>

5 TEST RESULTS

5.1 Test 0 – Pressure Test

- 5.1.1 The appliance has passed the requirements of the static pressure test, Test 0 of the BESA Test Regime as:
- 5.1.2 There was No damage observed during the static pressure test, with the primary flow pressurised to 14.3 bar (1.43 times the rated value), and,
- 5.1.3 There were No leaks observed during the static pressure test, with the primary flow pressurised to 14.3 bar (1.43 times the rated value).

5.2 Test 1a to 1f – Space Heating 1-4 kW at 70 and 60°C

- 5.2.1 The plot of the key metrics of Tests 1a-1f for the space heating 1 - 4 kW at both 70 and 60 °C are displayed in Figure 7.1 to Figure 7.6 respectively. See Table 5.1 for summarised test results including the average primary return temperature, t_{12}

Table 5.1 - Test Results for Space Heating Tests 1a to 1f

Test No & Description	Primary					Secondary				
	Flow Temperature	Return Temperature	Flow Rate	Differential Pressure	Heat Load	Return Temperature	Flow Temperature	Flow Rate	Differential Pressure	Heat Load
	$[t_{11}]$	$[t_{12}]$	$[q_1]$	$[\Delta p_1]$	$[P_1]$	$[t_{21}]$	$[t_{22}]$	$[q_2]$	$[\Delta p_2]$	$[P_2]$
	[°C]	[°C]	[Ls ⁻¹]	[kPa]	[W]	[°C]	[°C]	[Ls ⁻¹]	[kPa]	[W]
1a - 1 kW Space Heating (DH 70 °C flow)	69.6	42.0	0.011	53.9	1127	39.7	60.4	0.011	2.1	1046
1b - 2 kW Space Heating (DH 70 °C flow)	69.8	43.9	0.020	57.7	2154	39.8	60.4	0.025	1.3	2123
1c - 4 kW Space Heating (DH 70 °C flow)	69.6	44.9	0.041	57.2	4051	40.2	60.4	0.046	0.5	4091
1d - Space Heating 1 kW (DH 60 °C flow)	59.6	37.8	0.012	51.2	1029	34.7	45.4	0.023	1.9	1079
1e - Space Heating 2 kW (DH 60 °C flow)	59.6	37.7	0.024	40.9	2108	34.7	44.9	0.047	0.1	2005
1f - Space Heating 4 kW (DH 60 °C flow)	59.7	38.9	0.047	48.8	4065	34.7	45.4	0.090	5.4	4400

5.3 Test 2a – DHW Dynamic Tapping at 70 °C

- 5.3.1 The appliance has passed the requirements of the DHW only at 70 °C, Test 2a of the BESA Test Regime as:
- 5.3.2 The domestic hot water output temperature, t_{32} did not exceed 65 °C for more than 10 seconds.
- 5.3.3 The maximum and minimum temperatures of t_{32} were 56.6 °C and 41.5 °C respectively.
- 5.3.4 The plot of the key metrics of the duration of Test 2a is displayed in Figure 7.7, Appendix A.

5.4 Test 2b – DHW Dynamic Tapping at 60 °C

- 5.4.1 The maximum and minimum temperatures of t_{32} were 54.7 °C and 39.6 °C respectively.
- 5.4.2 The plot of the key metrics of the duration of Test 2b is displayed in Figure 7.8, Appendix A.

5.5 Test 3a & 3c – Low Flow DHW at 70 °C

- 5.5.1 The appliance has passed the requirements of the Low Flow at 70 °C, Test 3a of the BESA Test Regime as:
- 5.5.2 The domestic hot water output temperature, t_{32} did not exceed 65 °C for more than 10 seconds, and,
- 5.5.3 The appliance did not maintain the DHW output temperature, t_{32} at 55 ± 3 °C during the last 60 seconds of the test.
- 5.5.4 The maximum and minimum temperatures of t_{32} were 59.3 °C and 12.7 °C respectively.
- 5.5.5 As the appliance did not maintain a stable flow temperature at 1.2 l/min, the appliance was retested as test 3c at the manufacturers declared low flow rate which was 1.8 l/min.
- 5.5.6 At the manufacturers low flow rate of 1.8 l/min the appliance did maintain the DHW output temperature t_{32} at 55 ± 3 °C during the last 60 seconds of the test.
- 5.5.7 The plot of the key metrics of the duration of Test 3a is displayed in Figure 7.9, Appendix A.
- 5.5.8 The plot of the key metrics of the duration of Test 3c is displayed in Figure 7.11, Appendix A.

5.6 Test 3b & 3d – Low Flow DHW at 60 °C

- 5.6.1 The appliance did not maintain stable flow temperatures during Low Flow at 60 °C, Test 3b of the BESA Test Regime.
- 5.6.2 The appliance was retested as test 3d at the manufacturers declared low flow rate which was 1.8 l/min, the appliance was then seen to maintain DHW output temperature t_{32} at 50°C during the last 60 seconds of the test.
- 5.6.3 The plot of the key metrics of the duration of Test 3b is displayed in Figure 7.10, Appendix A. Test 3d is displayed in Figure 7.12, Appendix A.

5.7 Test 4a – Keep-Warm at 70 °C

- 5.7.1 The appliance has passed the requirements of the Keep-Warm at 70 °C, Test 4a of the BESA Test Regime as:
- 5.7.2 This is a valid keep warm operation based on 5a response time criteria, see 5.9.3.
- 5.7.3 The appliance is performing keep-warm cycling as the primary flow temperature, t_{11} varies by more than ± 3 °C during the final 3 hours of the test. Please see BESA HIU Standard technical note TN-018 Version 1 for a more detailed definition of cyclical data.
- 5.7.4 The average heat load on the primary side P_1 is 35 W.
- 5.7.5 The average electrical consumption was 2.44 W.
- 5.7.6 The average primary flow q_1 over the 8 hours test was 3.4 l/hr.
- 5.7.7 The keep-warm control was set to on.
- 5.7.8 The plot of the key metrics of the duration of Test 4a is displayed in Figure 7.13, Appendix A.

5.8 Test 4b – Keep-Warm at 60 °C

- 5.8.1 The appliance has passed the requirements of the Keep-Warm at 60 °C, Test 4b of the BESA Test Regime as:
- 5.8.2 This is a valid keep warm operation based on 5b response time criteria, see 5.10.1.
- 5.8.3 The appliance is performing keep-warm cycling as the primary flow temperature, t_{11} varies by more than ± 3 °C during the final 3 hours of the test. Please see BESA HIU Standard technical note TN-018 Version 1 for a more detailed definition of cyclical data.
- 5.8.4 The average heat load on the primary side P_1 is 29 W.
- 5.8.5 The average primary flow q_1 over the 8 hours test was 5.2 l/hr.
- 5.8.6 The average electrical consumption was 2.42 W.
- 5.8.7 The keep-warm control was set to on.

The plot of the key metrics of the duration of Test 4b is displayed in Figure 7.14, Appendix A.

5.9 Test 5a – DHW Response Time at 70 °C

- 5.9.1 The appliance has passed the requirements of DHW Response Time at 70 °C, Test 5a of the BESA Test Regime as:
- 5.9.2 The domestic hot water output temperature, t_{32} did not exceed 65 °C for more than 10 seconds.
- 5.9.3 The DHW response time for t_{32} to reach 45 °C (and not subsequently drop below 42 °C) was 13 seconds; therefore this is a valid keep warm.
- 5.9.4 The plot of the key metrics of the duration of Test 5a is displayed in Figure 7.15, Appendix A.

5.10 Test 5b – DHW Response Time at 60 °C

- 5.10.1 The DHW response time for t_{32} to reach 45 °C (and not subsequently drop below 42 °C) was 15 seconds; therefore this is a valid keep warm.
- 5.10.2 The plot of the key metrics of the duration of Test 5b is displayed in Figure 7.16, Appendix A.

5.11 Overall Scaling Risk Assessment

- 5.11.1 If any of the below factors occur, then the risk of scaling of the DHW plate in hard water areas increases.

Table 5.2 - Overall Scaling Risk Assessment

<i>HIU has a TMV or TRV on the output of the DHW plate heat exchanger.</i>	No	
Test Designation	2a	3a
<i>t₃₂ above 60°C for more than 5 seconds</i>	No	No
<i>t₁₂ exceeds 55°C at any point of the test</i>	No	No
Test Designation	4a	4b
<i>t₁₂ exceeds 50°C at any time</i>	No	No

5.12 VWART Calculations

- 5.12.1 The Volume Weighted Average Return Temperatures (VWART) have been calculated as stipulated in the BESA UK HIU Test Regime document. The calculated VWART values for both the high temperature and low temperature tests described in this report are given below in Table 5.3 and Table 5.4 respectively.

Table 5.3 – High Temperature VWART Calculations

Description	Symbol	Value	Unit
Annual Heating Period Percentage	SH _{PROP}	6.9	%
Annual Non-Heating Period Percentage	NSH _{PROP}	93.1	%
Space Heating Volume Weighted Return Temperature	VWART _{SH}	44	°C
DHW Volume Weighted Return Temperature	VWART _{DHW}	23	°C
Keep Warm Volume Weighed Return Temperature	VWART _{KWM}	42	°C
Annual Volume Weighted Return Temperature for Heating Period	VWART _{HEAT}	43	°C
Annual Volume Weighted Return Temperature for Non-Heating	VWART _{NONHEAT}	33	°C
Total Annual Volume Weighted Return Temperature	VWART _{OVERALL}	33	°C

Table 5.4 – Low Temperature VWART Calculations

Description	Symbol	Value	Unit
Annual Heating Period Percentage	SH _{PROP}	6.4	%
Annual Non-Heating Period Percentage	NSH _{PROP}	93.6	%
Space Heating Volume Weighted Return Temperature	VWART _{SH}	38	°C
DHW Volume Weighted Return Temperature	VWART _{DHW}	24	°C
Keep Warm Volume Weighed Return Temperature	VWART _{KWM}	40	°C
Annual Volume Weighted Return Temperature for Heating Period	VWART _{HEAT}	38	°C
Annual Volume Weighted Return Temperature for Non-Heating	VWART _{NONHEAT}	33	°C
Total Annual Volume Weighted Return Temperature	VWART _{OVERALL}	34	°C

6 CONCLUSIONS

6.1.1 The appliance has passed the performance requirements of the BESA HIU Test Regime.

7 APPENDIX A

7.1 Key Metric Plots

- 7.1.1 The graphical plots of the key metrics of the tests described in this report are given in this section.

GRAPHICAL PLOTS START ON NEXT PAGE

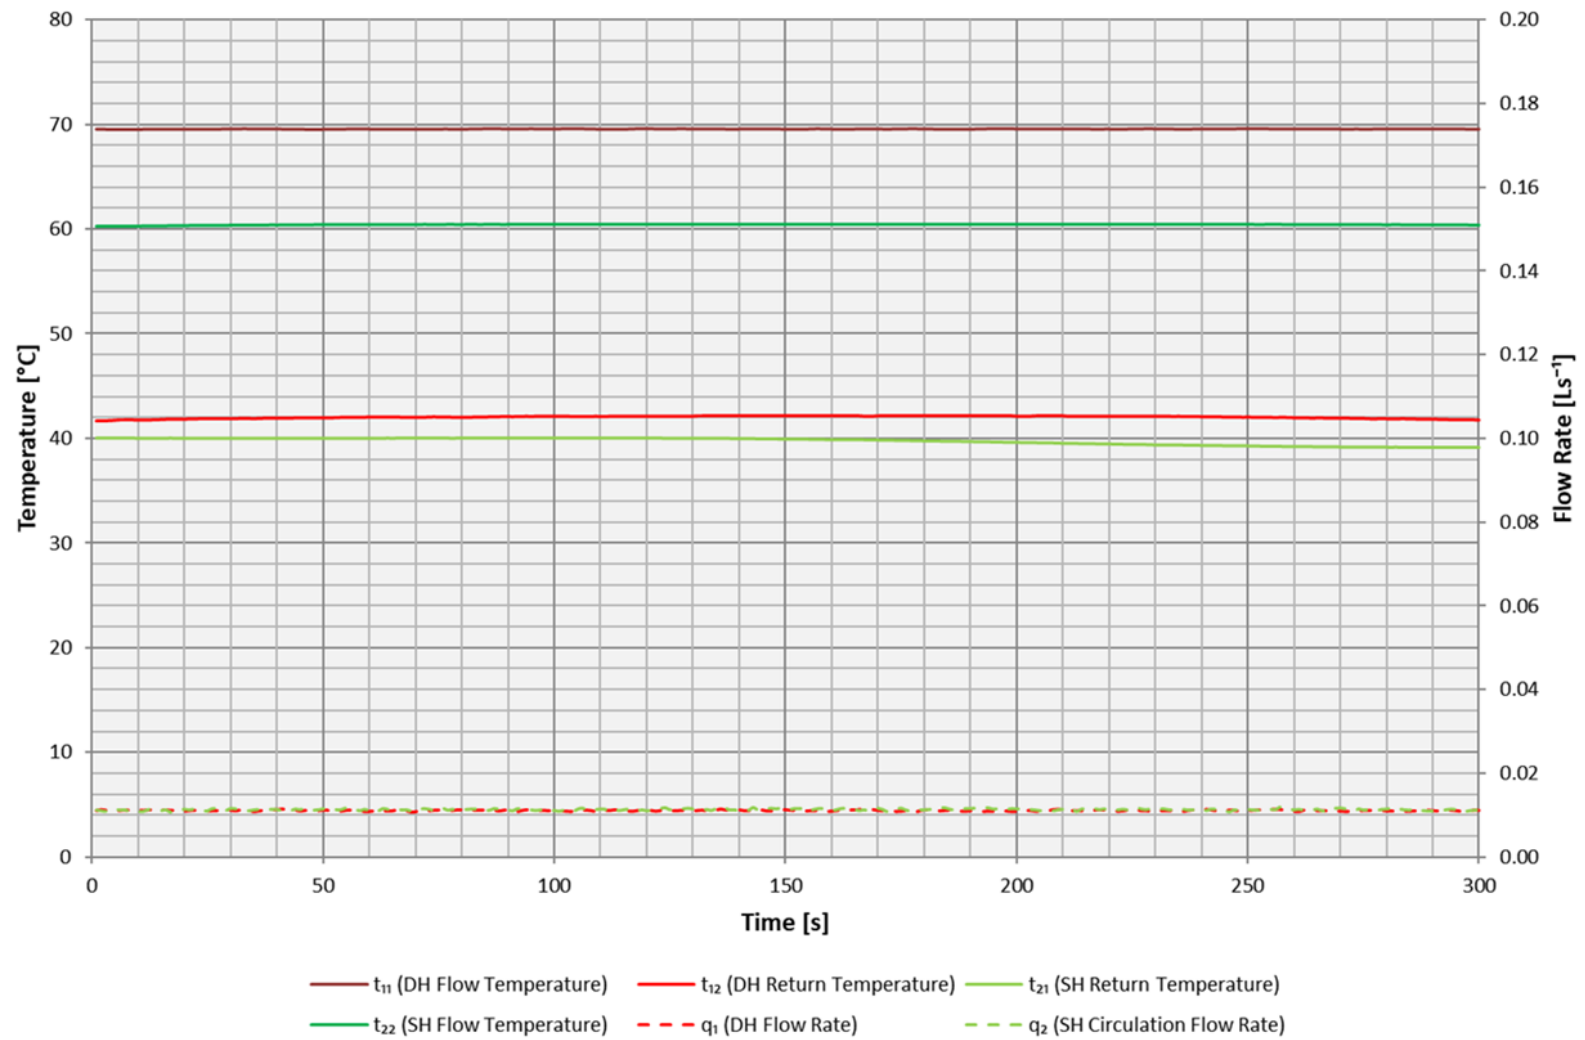


Figure 7.1 - Test 1a – Space Heating 1 kW at 70 °C

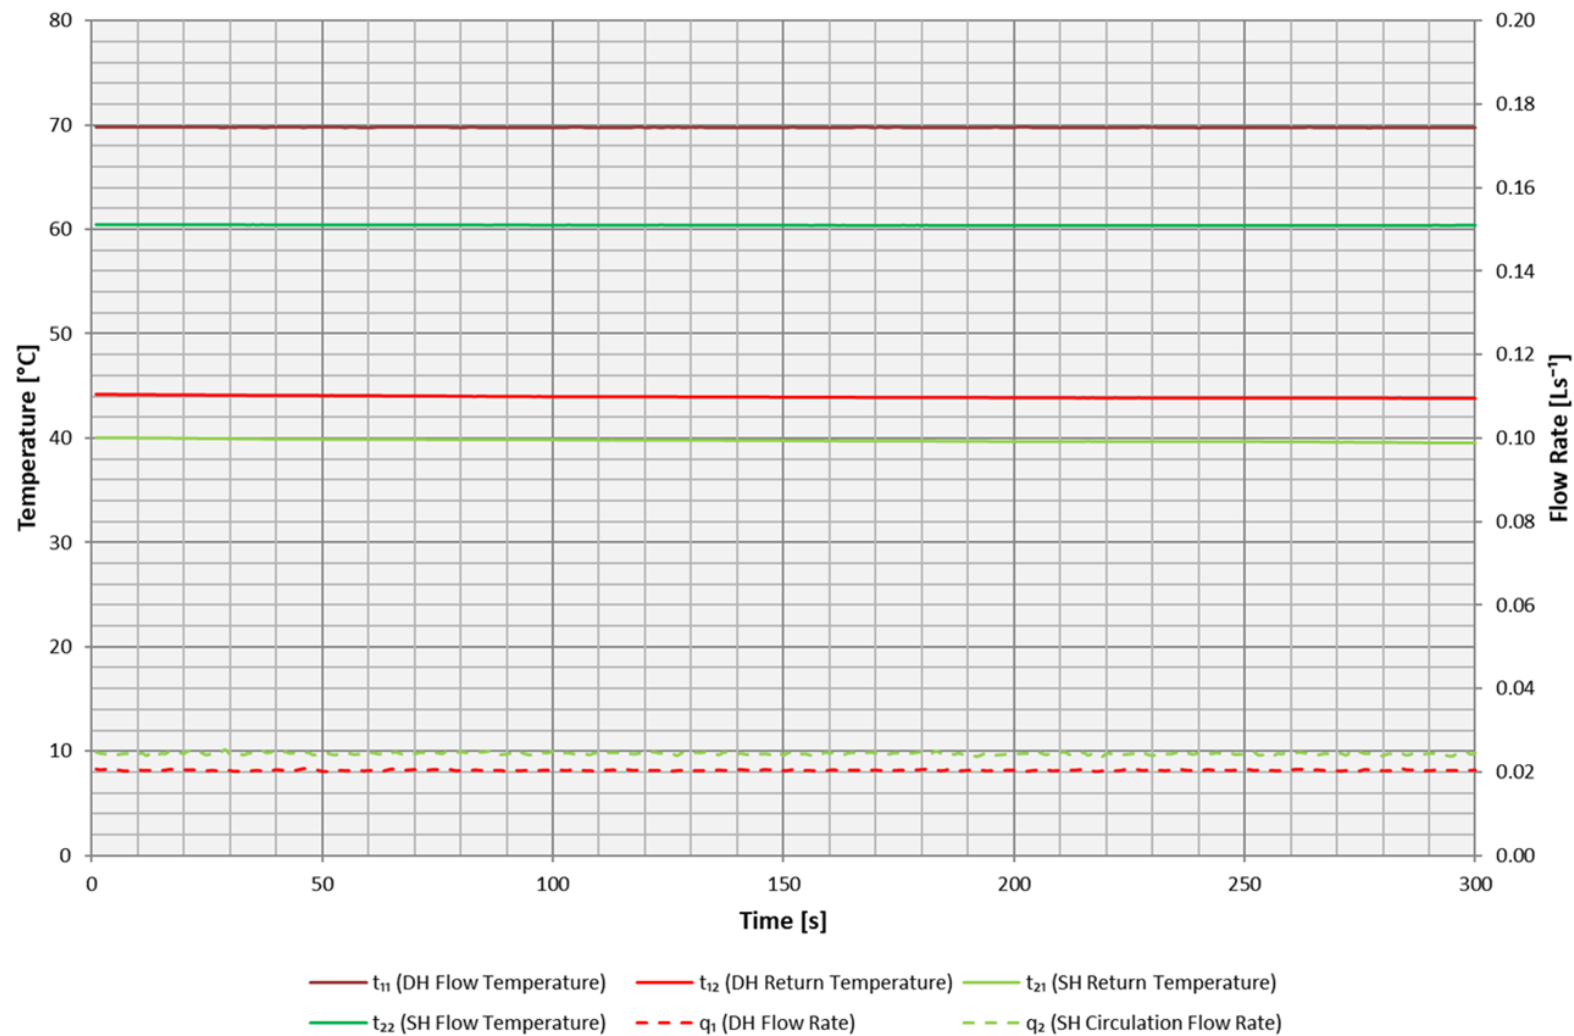


Figure 7.2 - Test 1b – Space Heating 2 kW at 70 °C

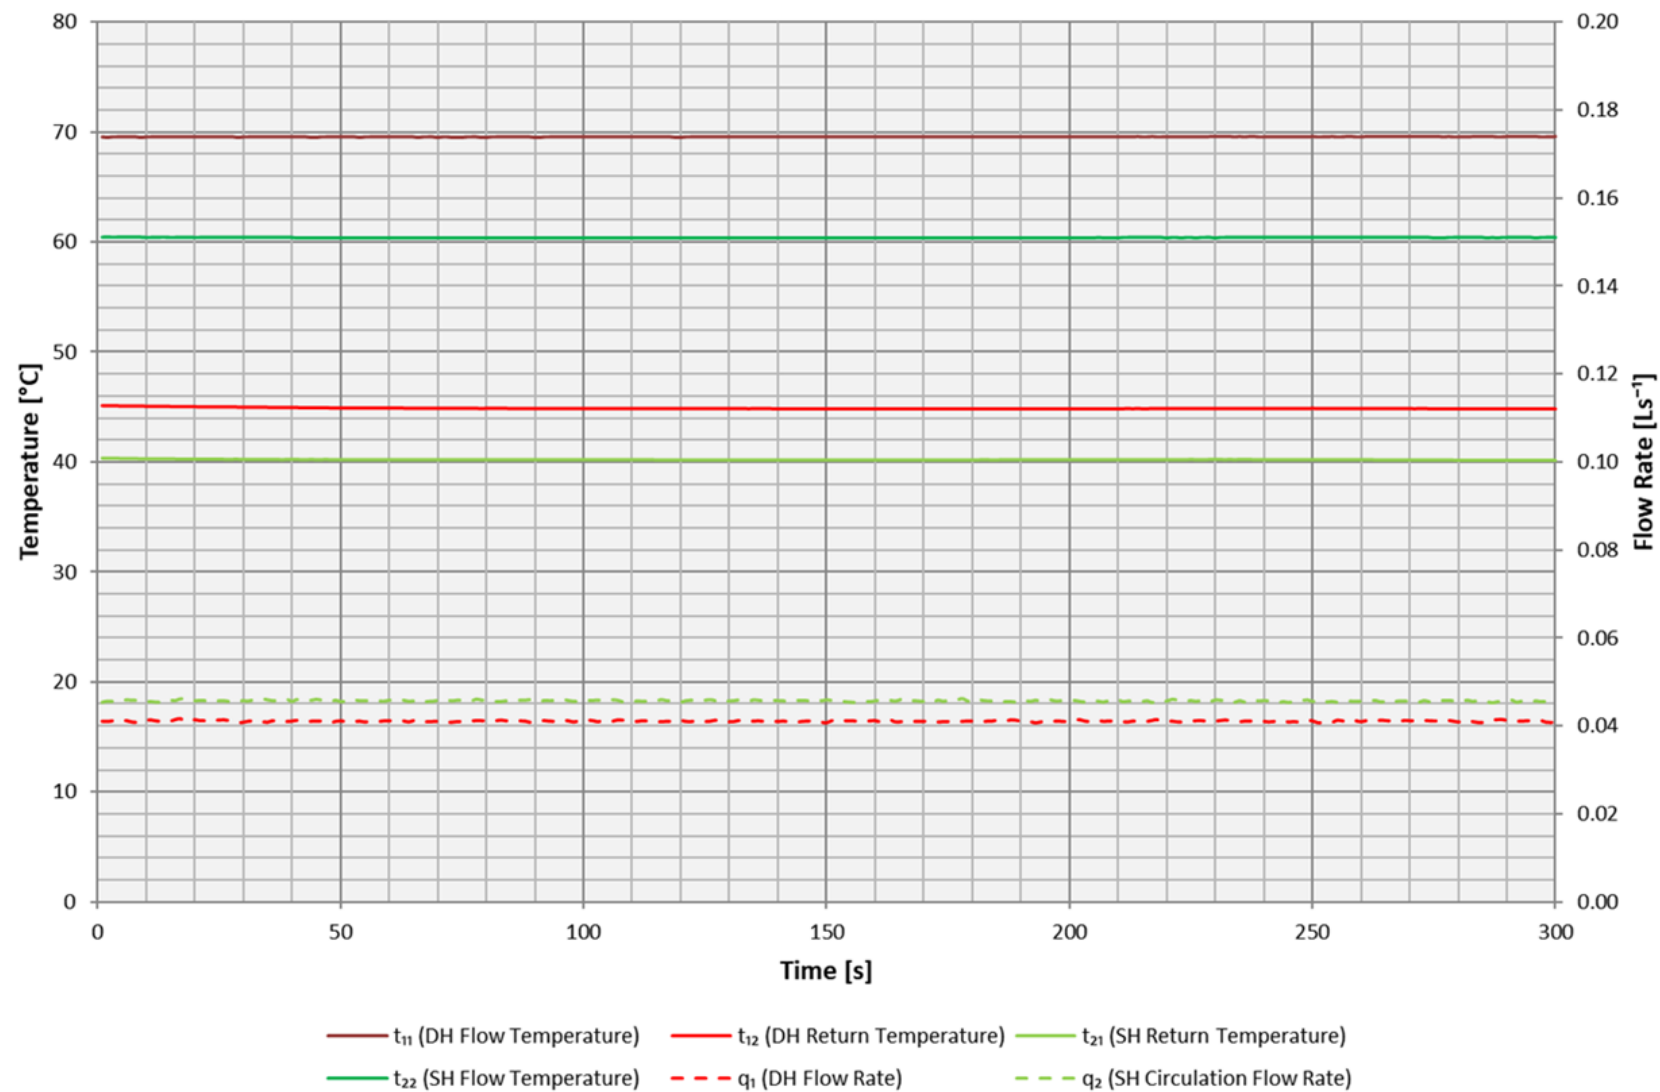


Figure 7.3 - Test 1c – Space Heating 4 kW at 70 °C

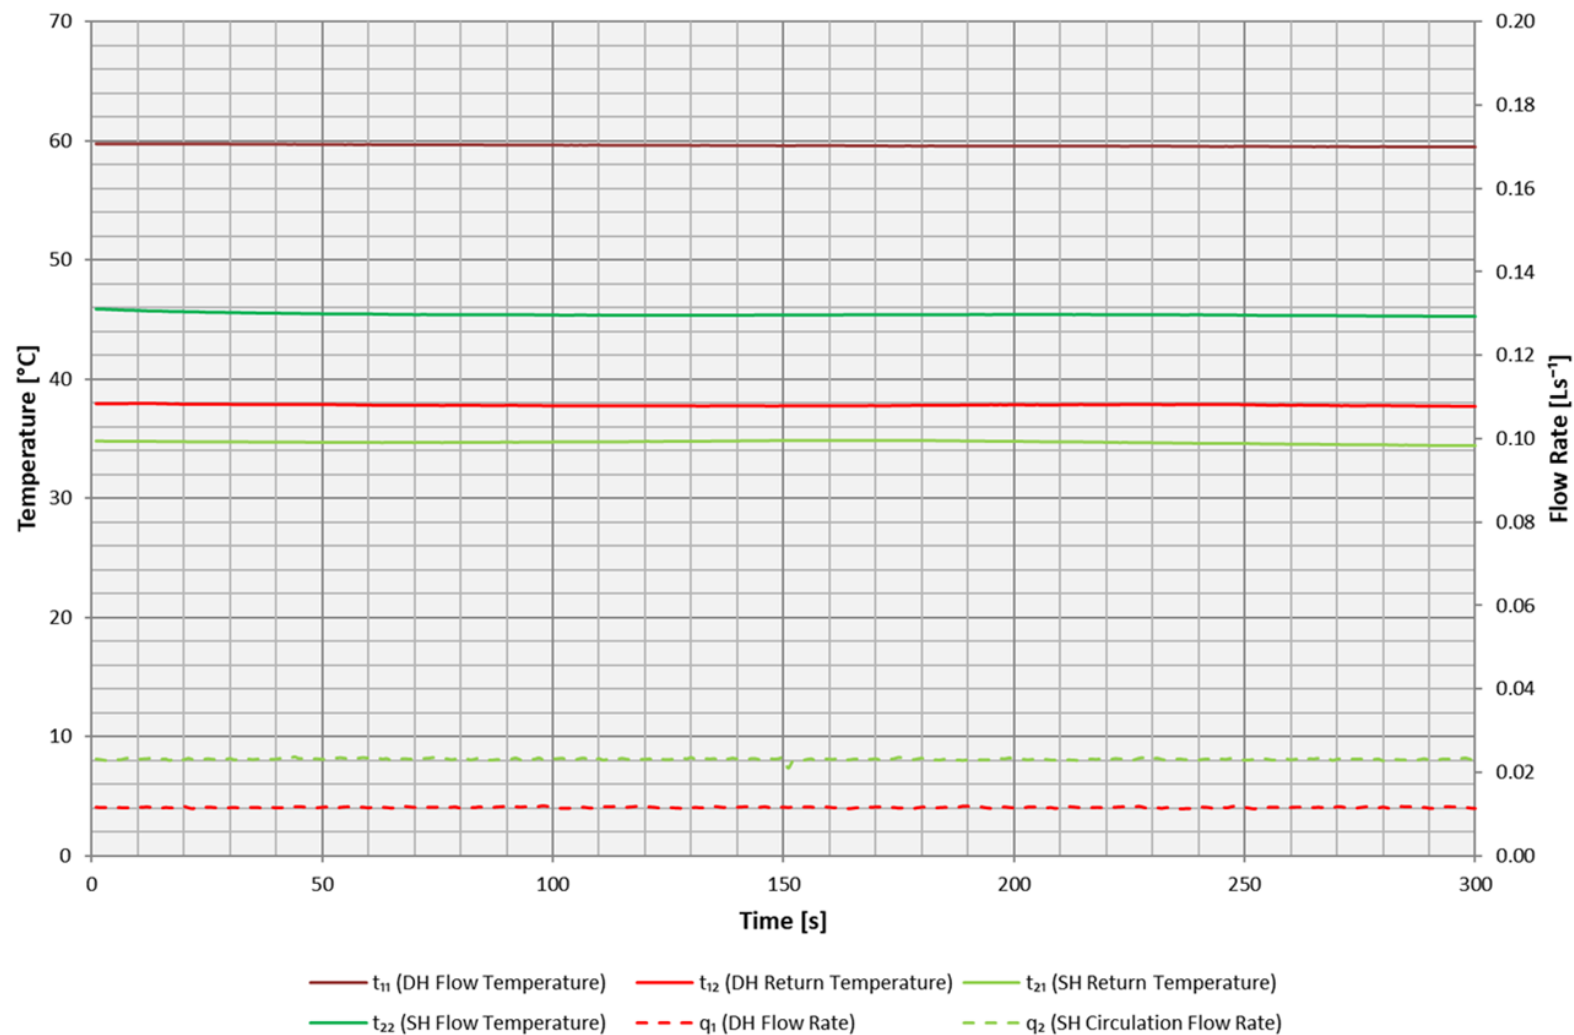


Figure 7.4 - Test 1d – Space Heating 1 kW at 60 °C

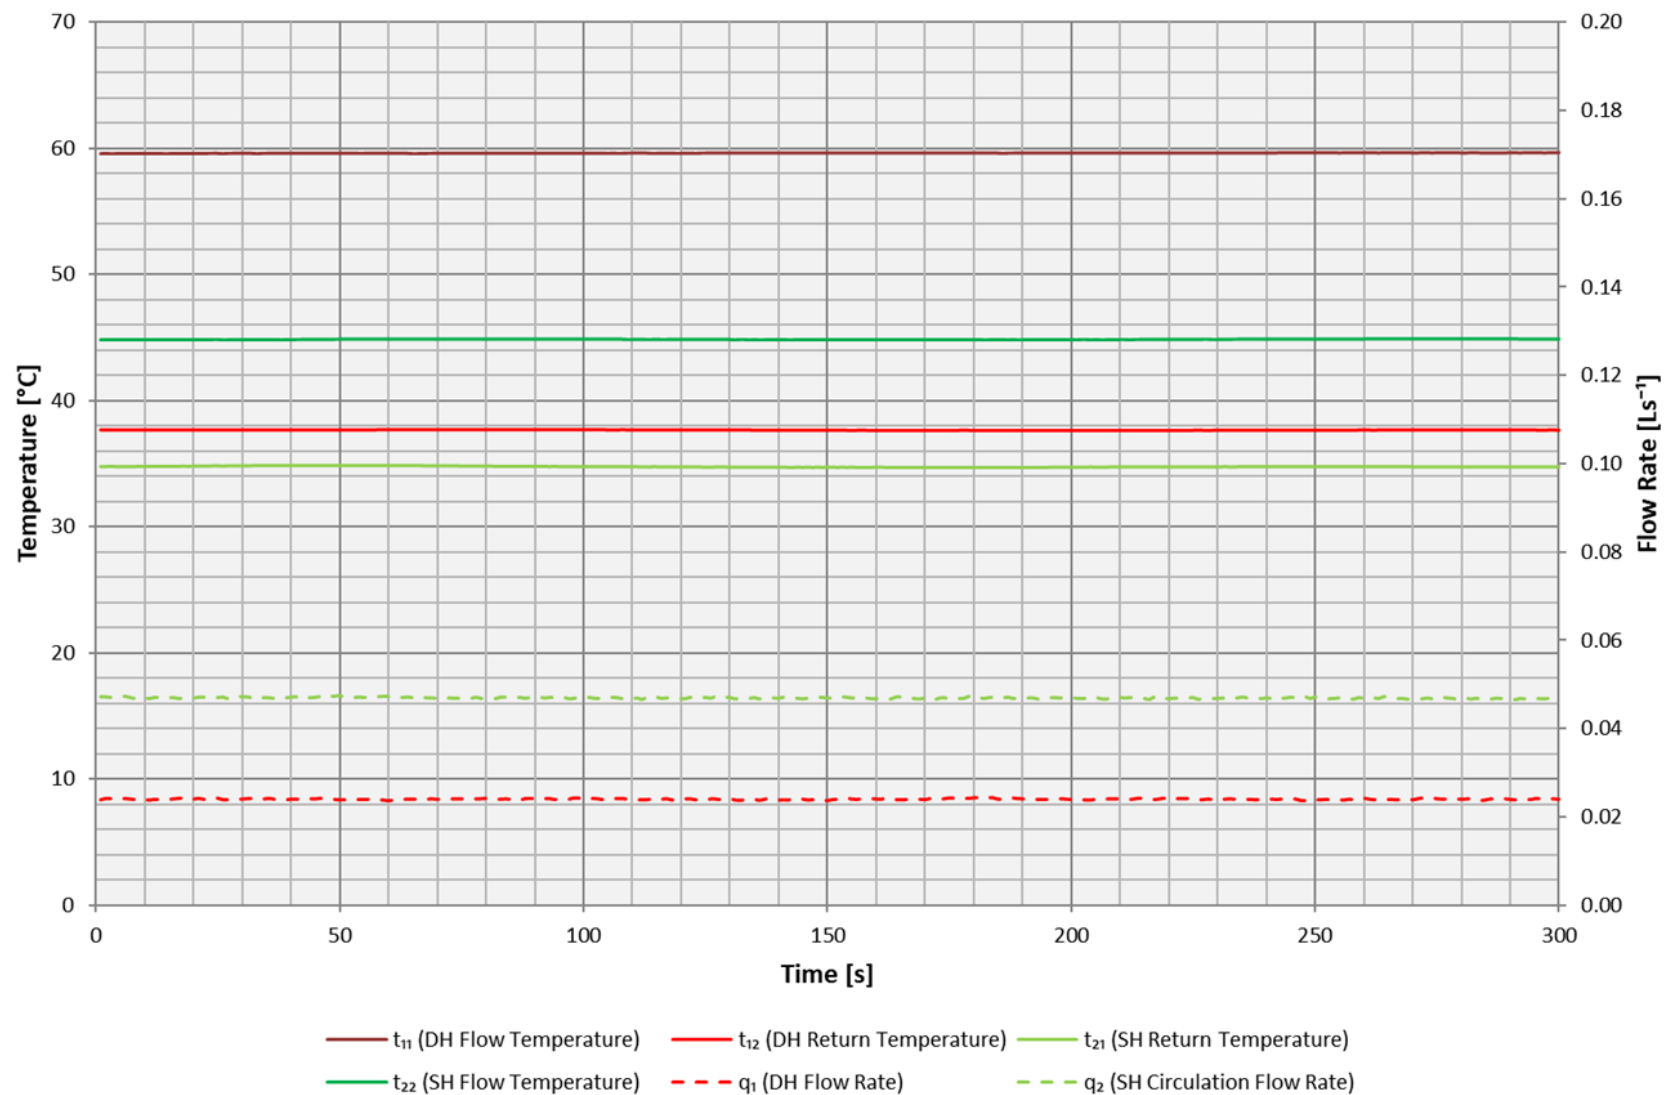


Figure 7.5 - Test 1e – Space Heating 2 kW at 60 °C

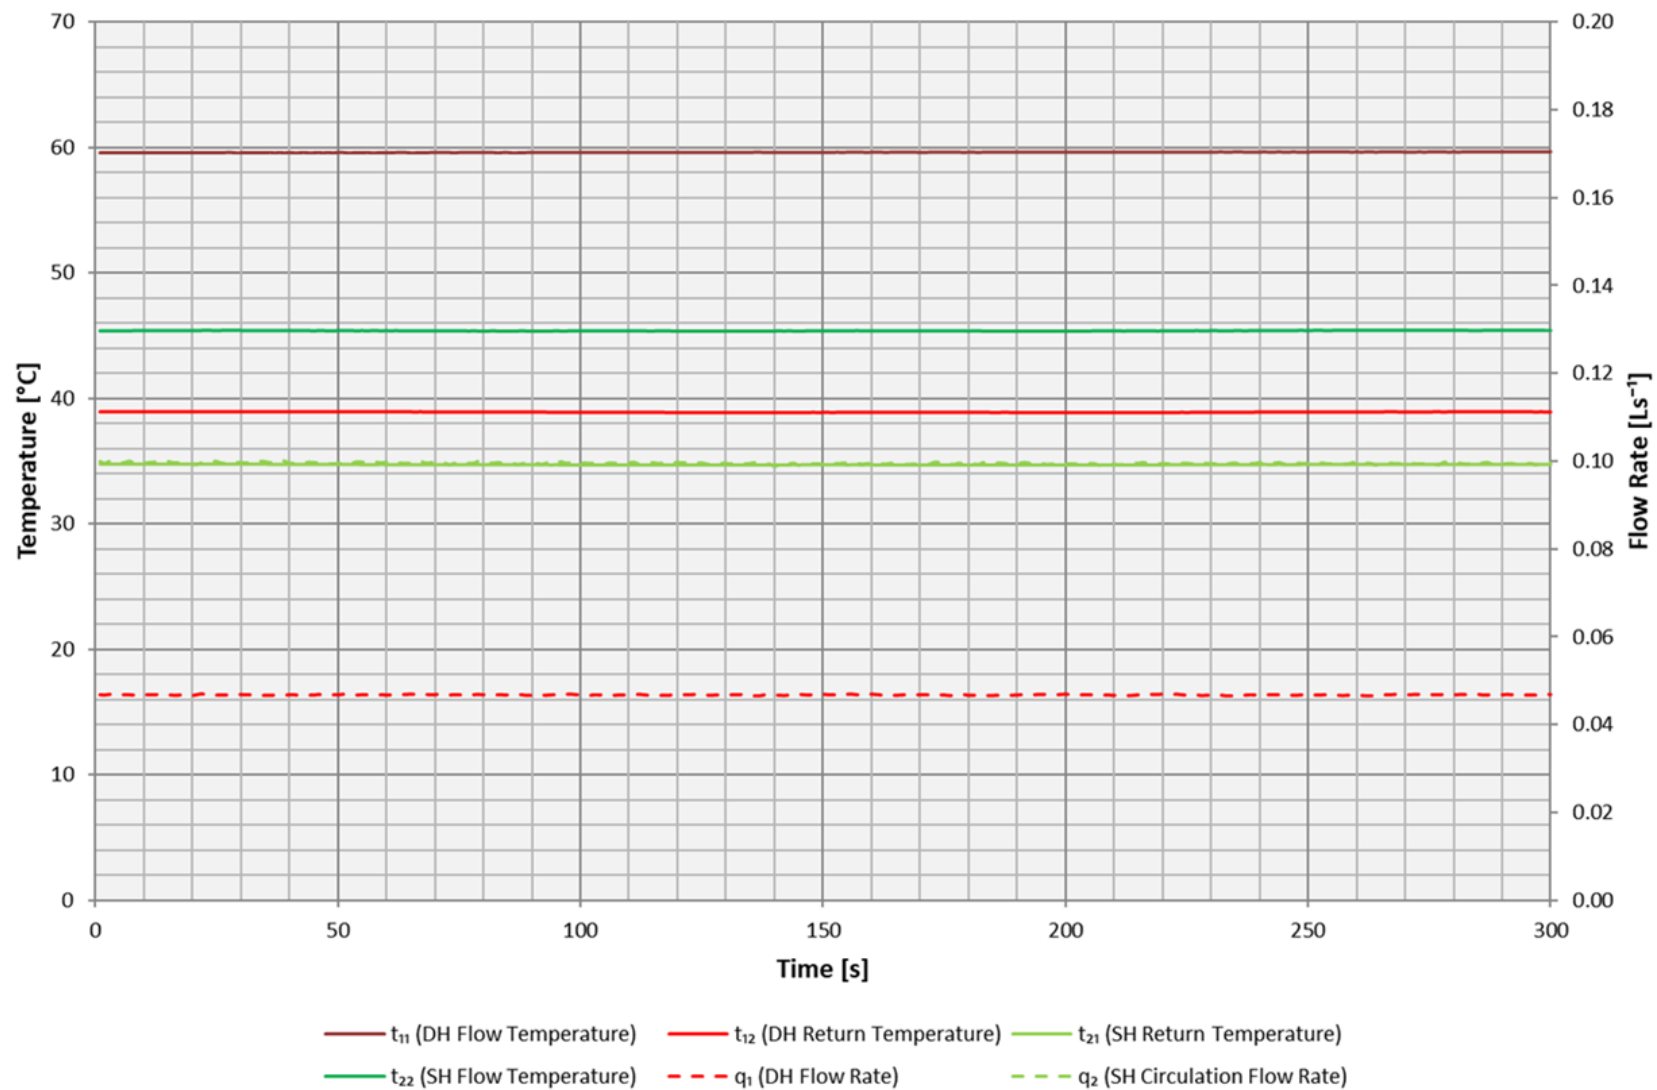


Figure 7.6 - Test 1f – Space Heating 4 kW at 60 °C

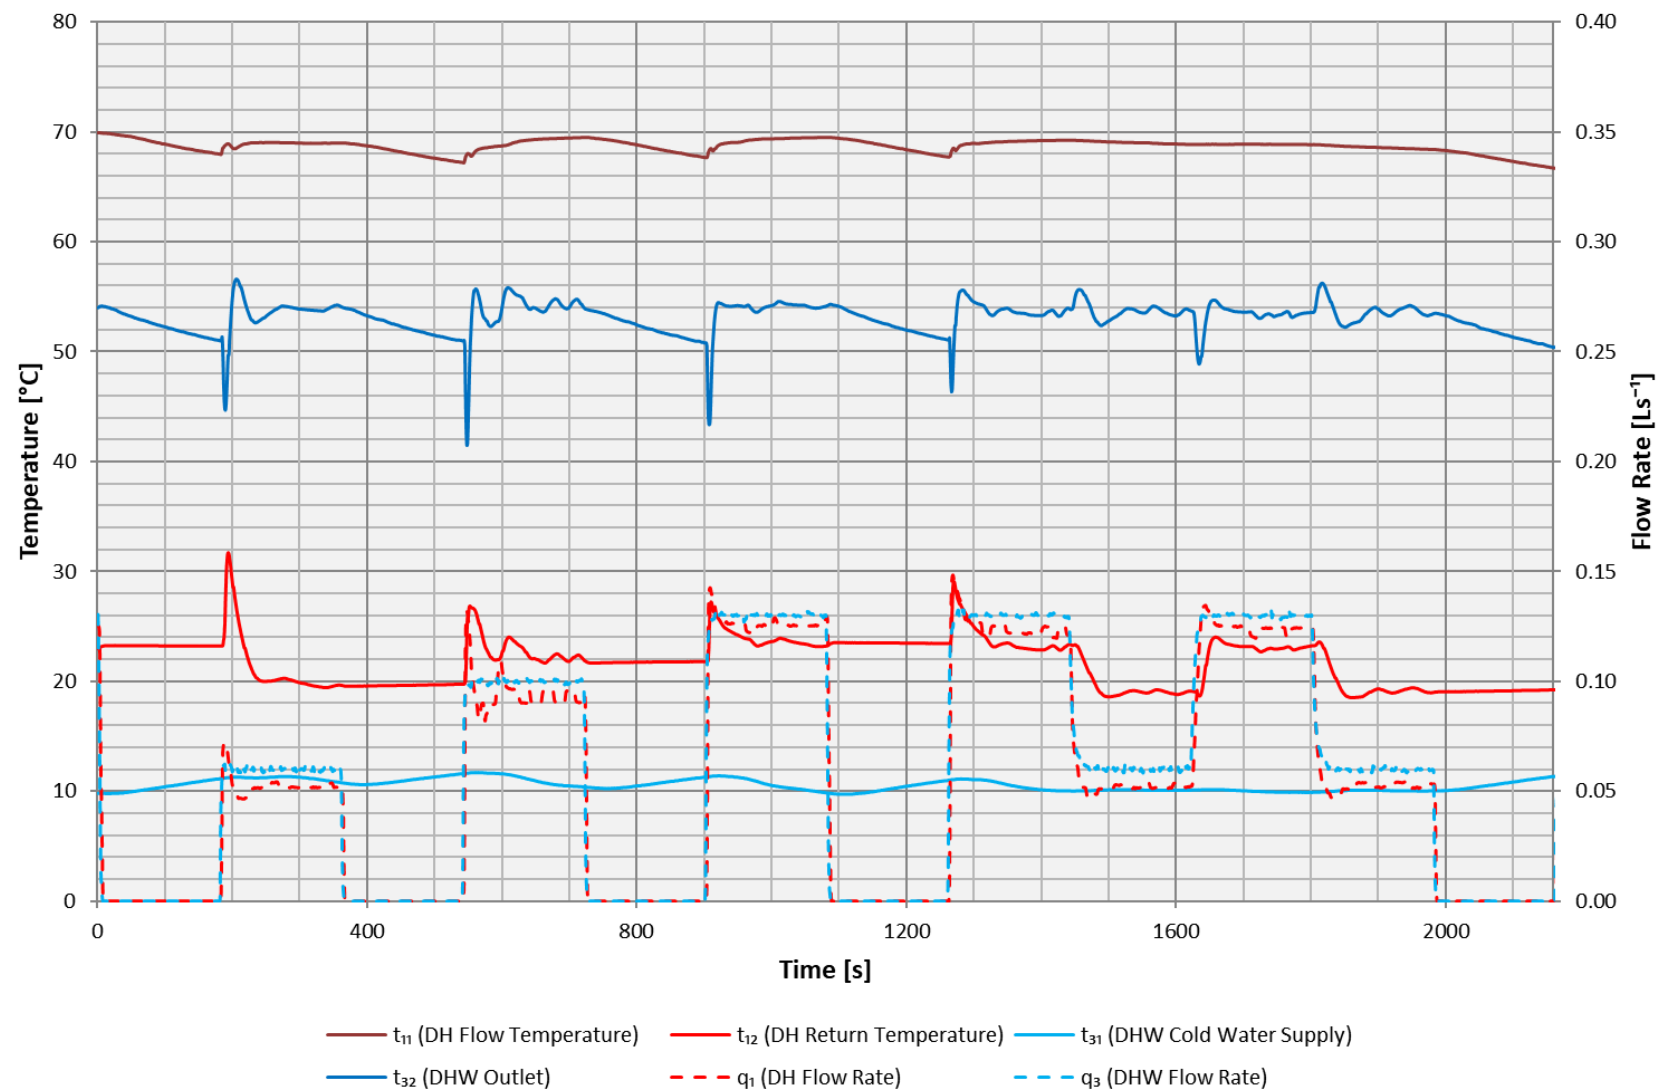


Figure 7.7 - Test 2a – DHW only at 70 °C

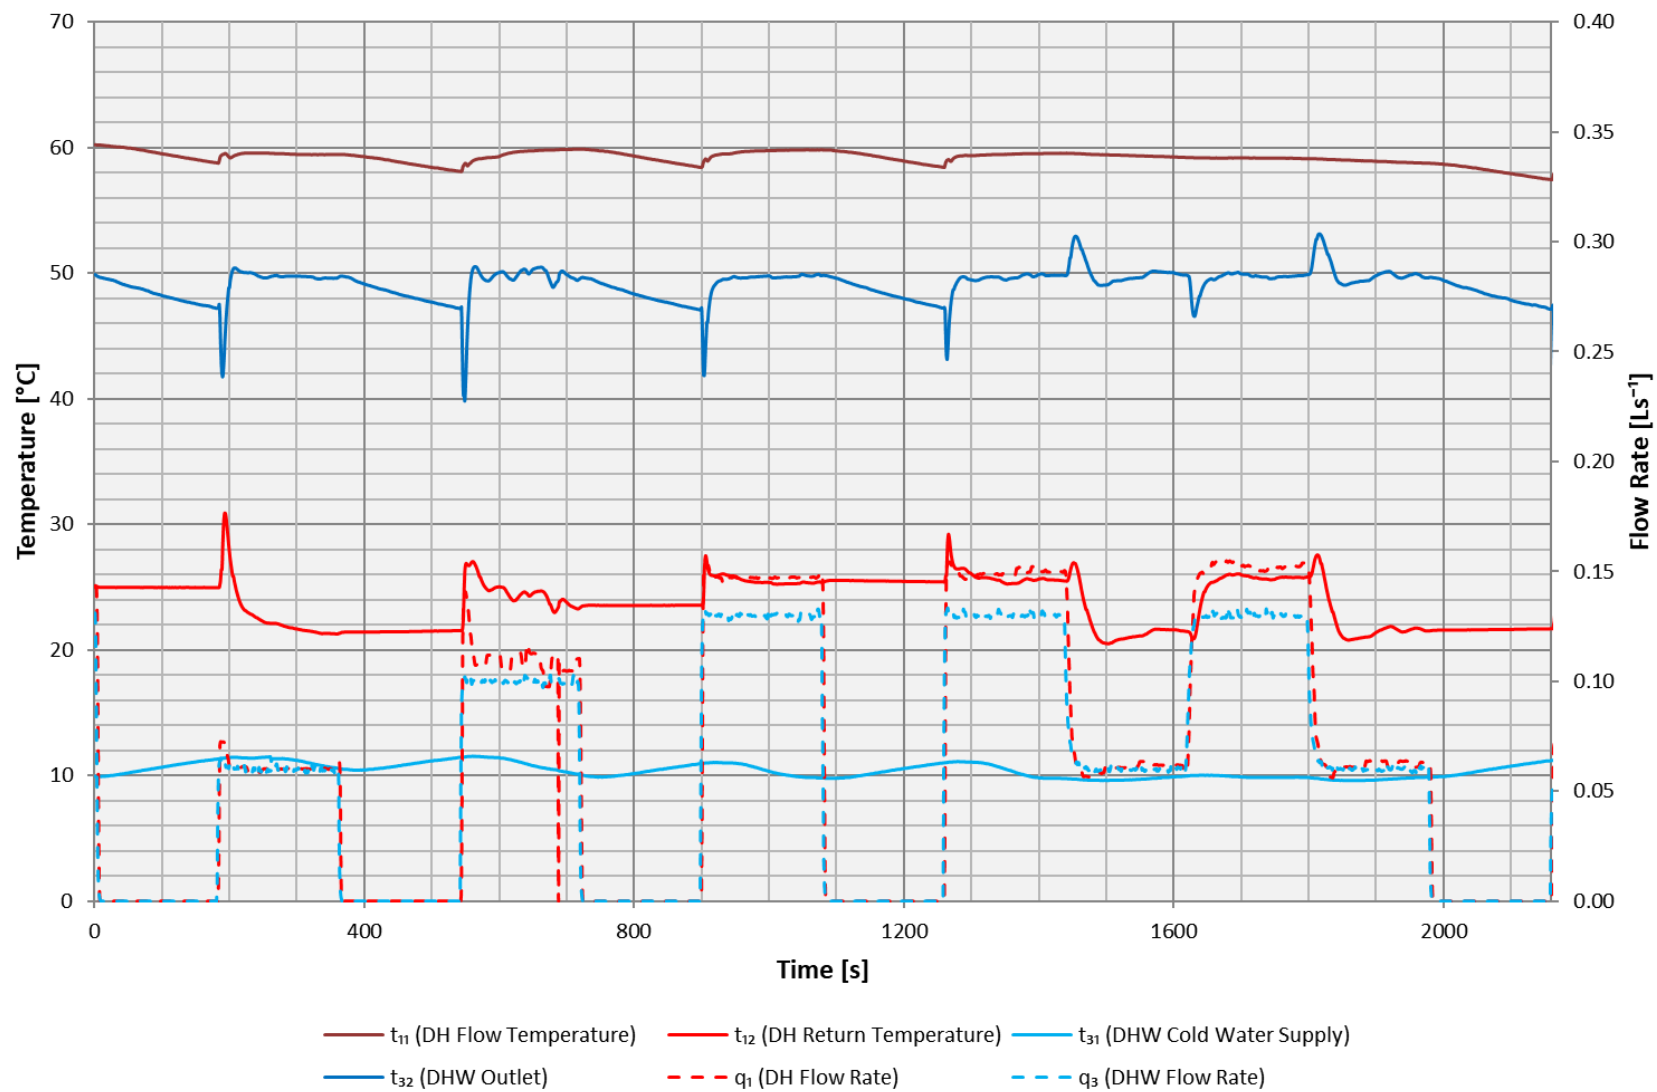


Figure 7.8 - Test 2b – DHW only at 60 °C

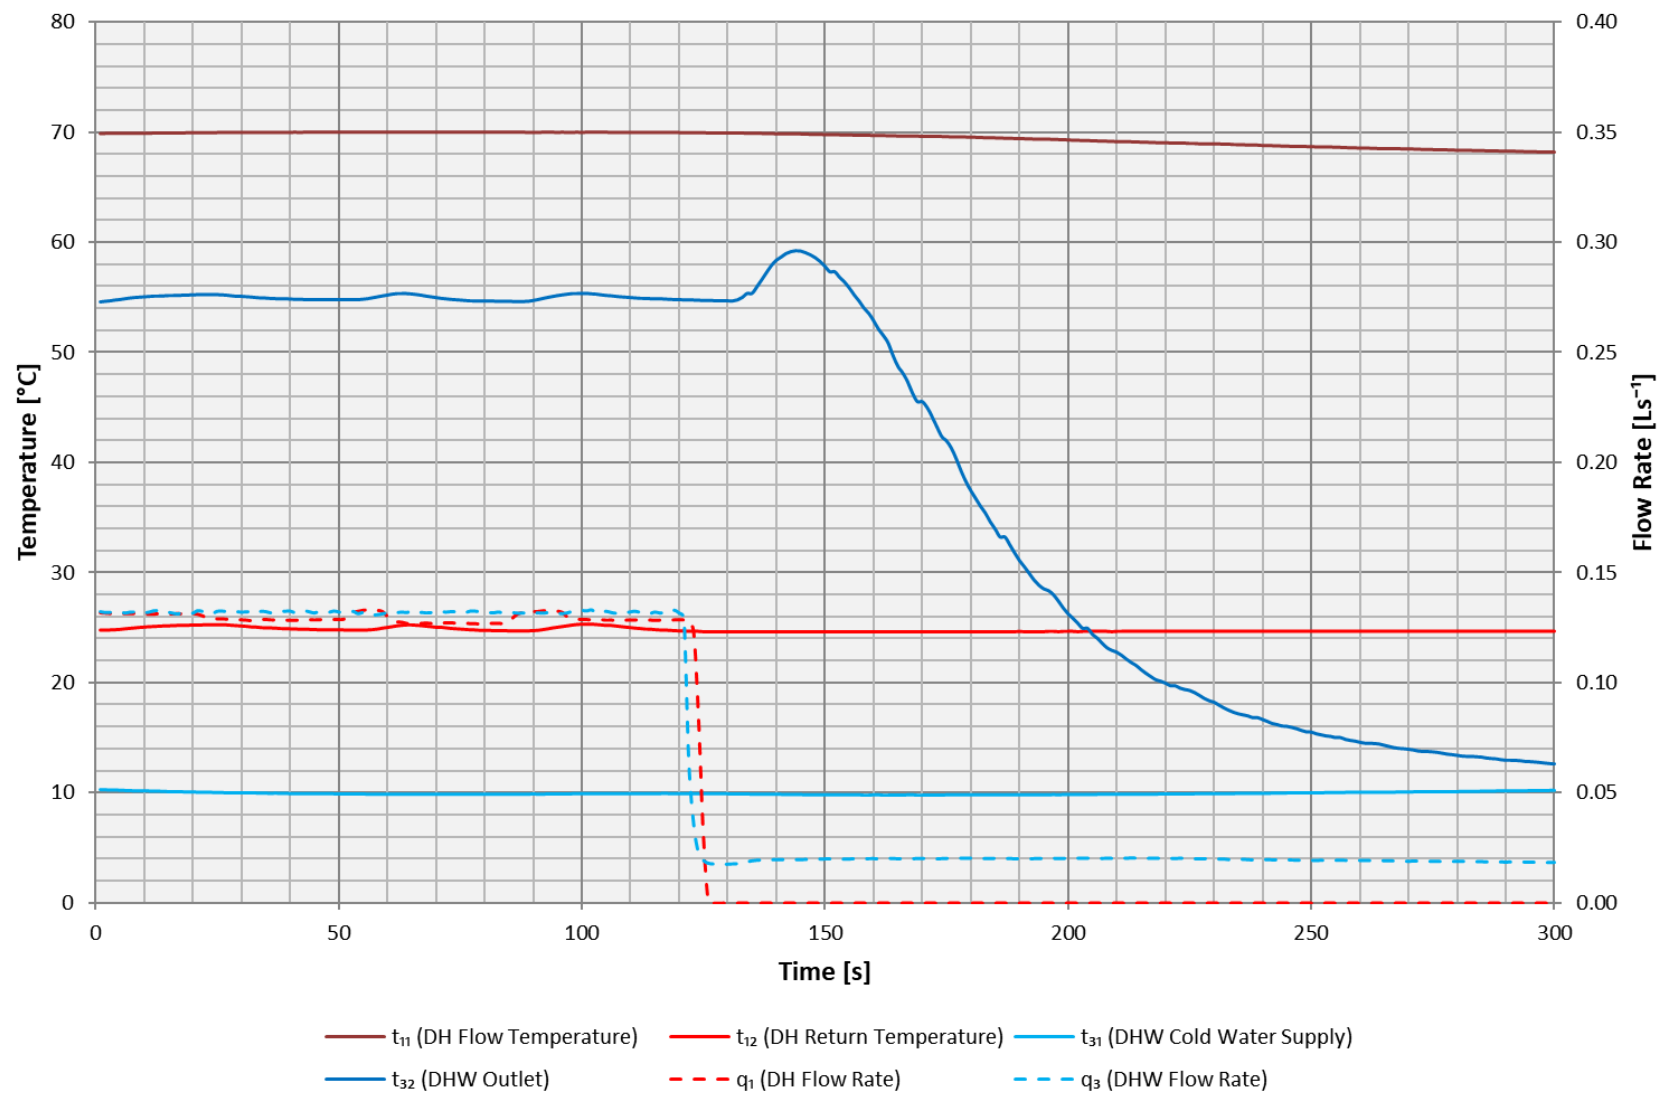


Figure 7.9 - Test 3a – Low Flow DHW at 70 °C

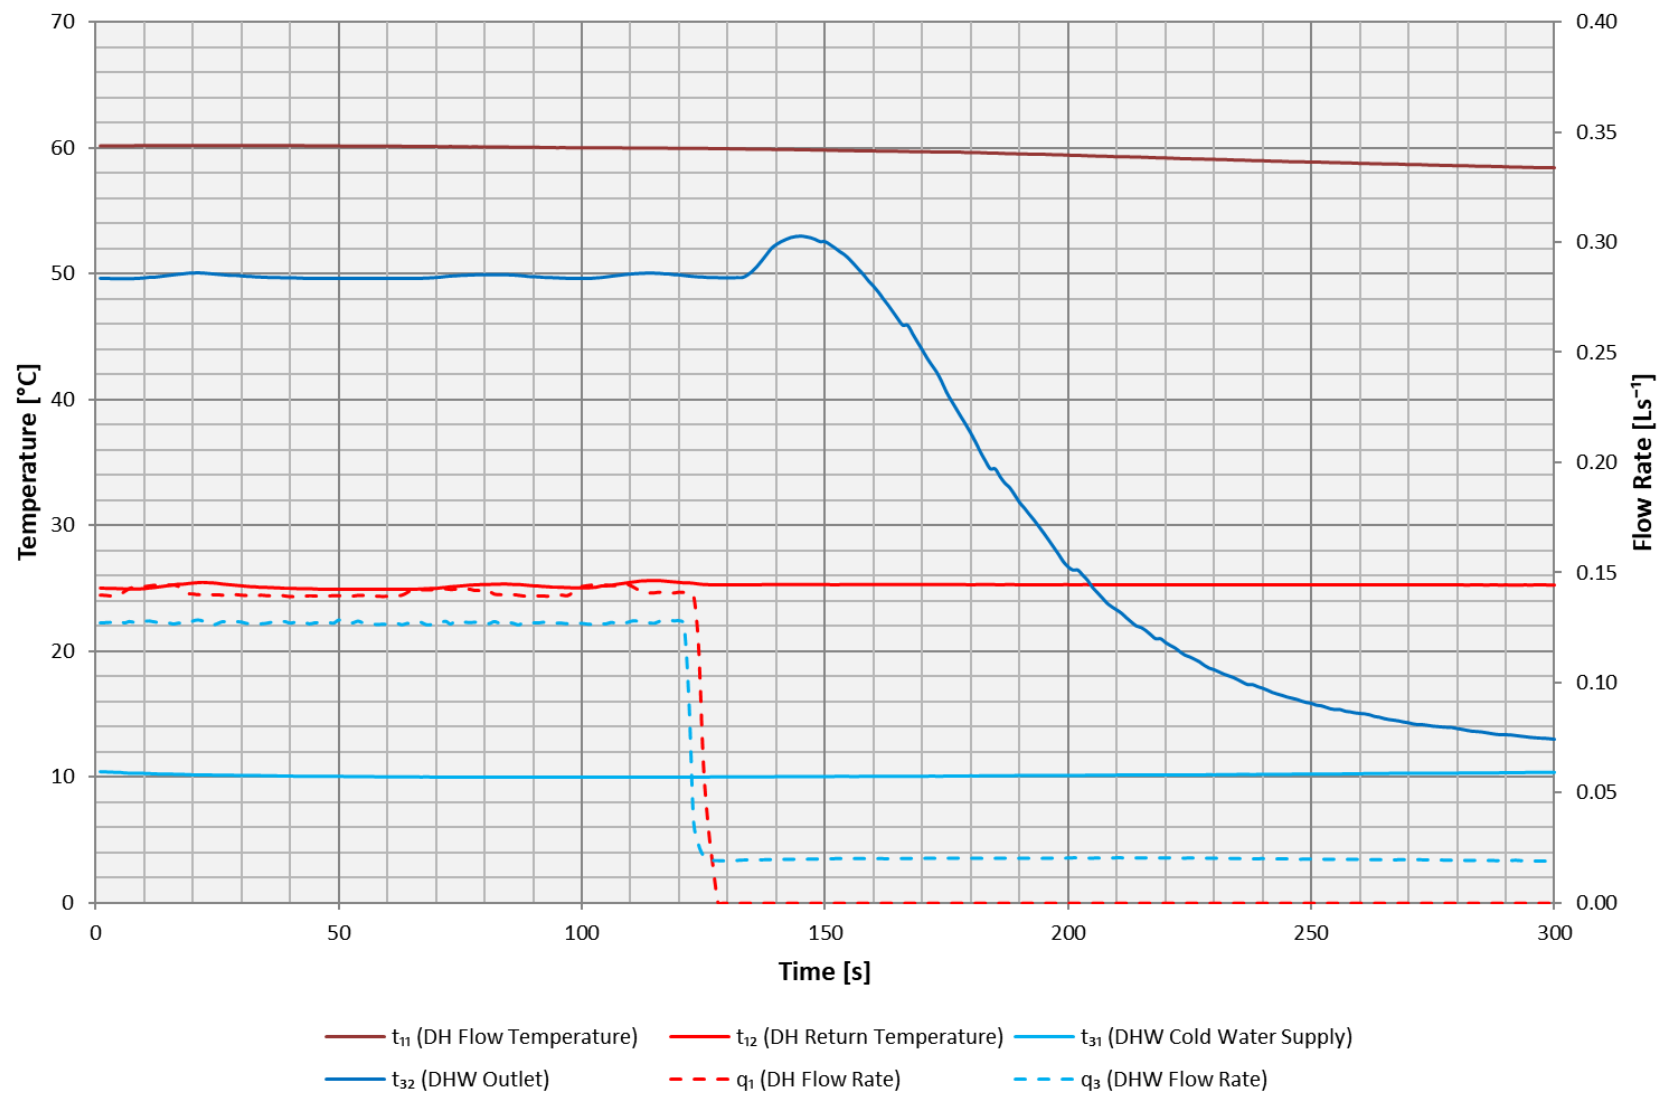


Figure 7.10 - Test 3b – Low Flow DHW at 60 °C

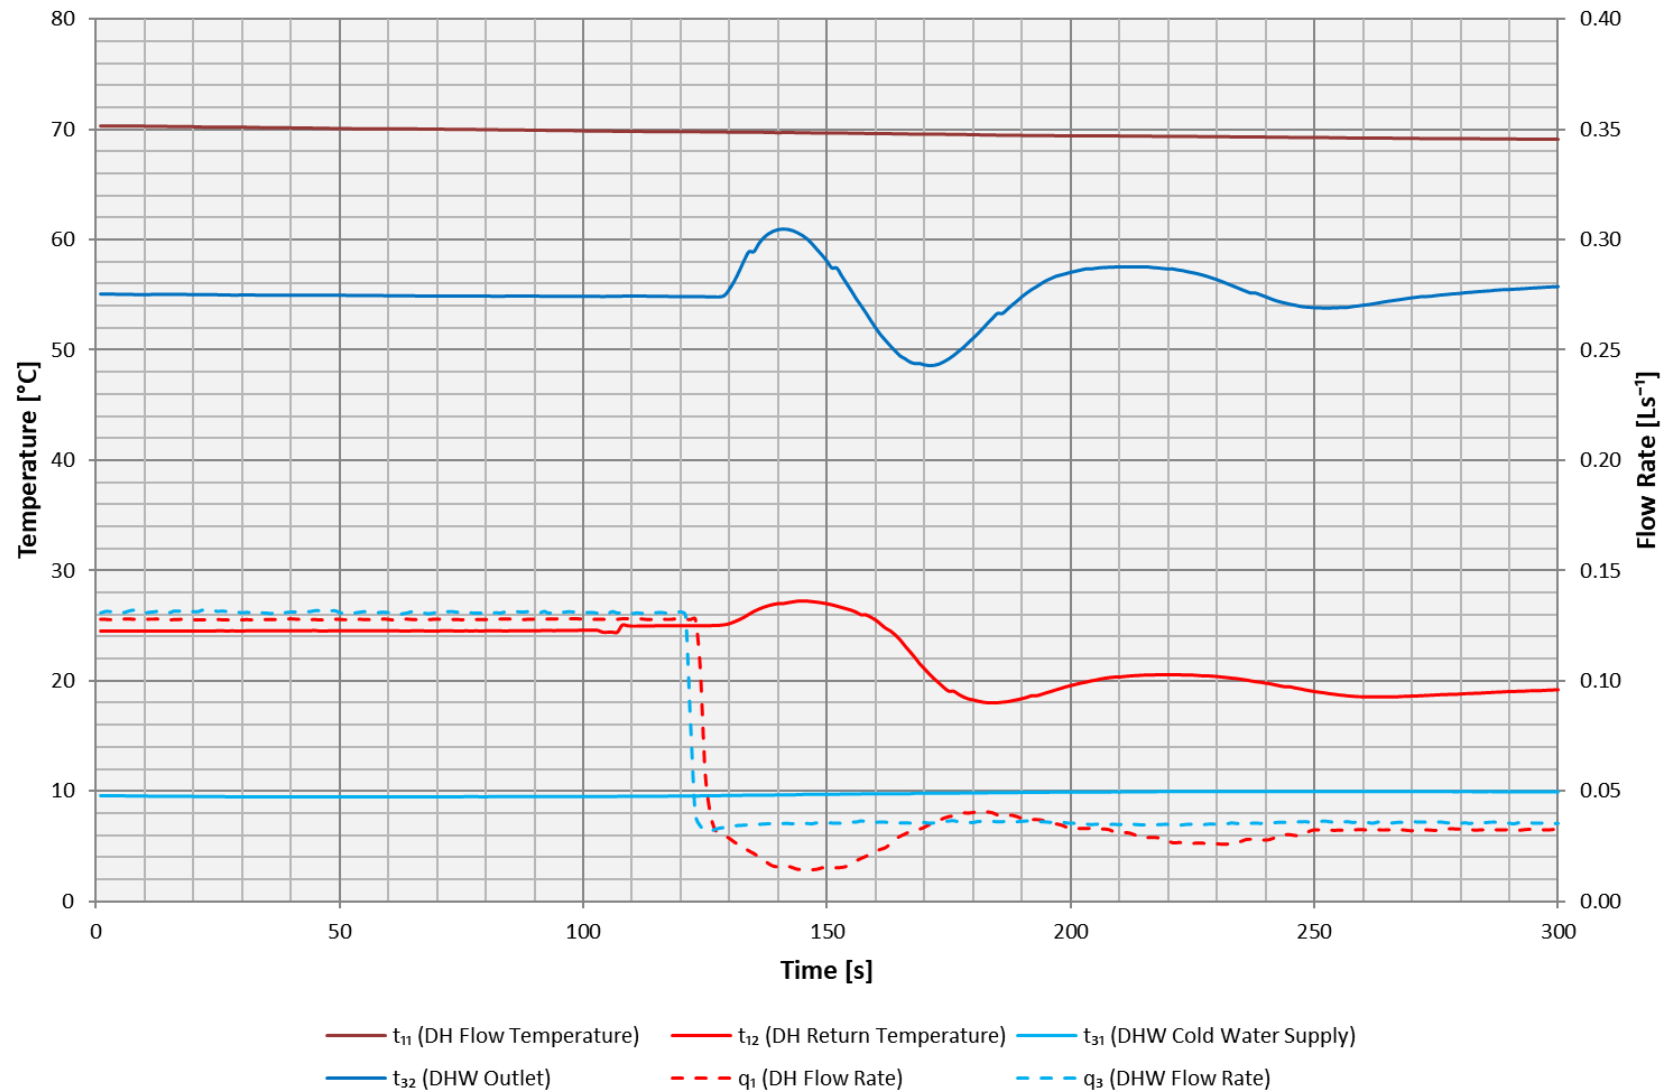


Figure 7.11 - Test 3c – Manufacturers Declared Low Flow DHW at 70 °C

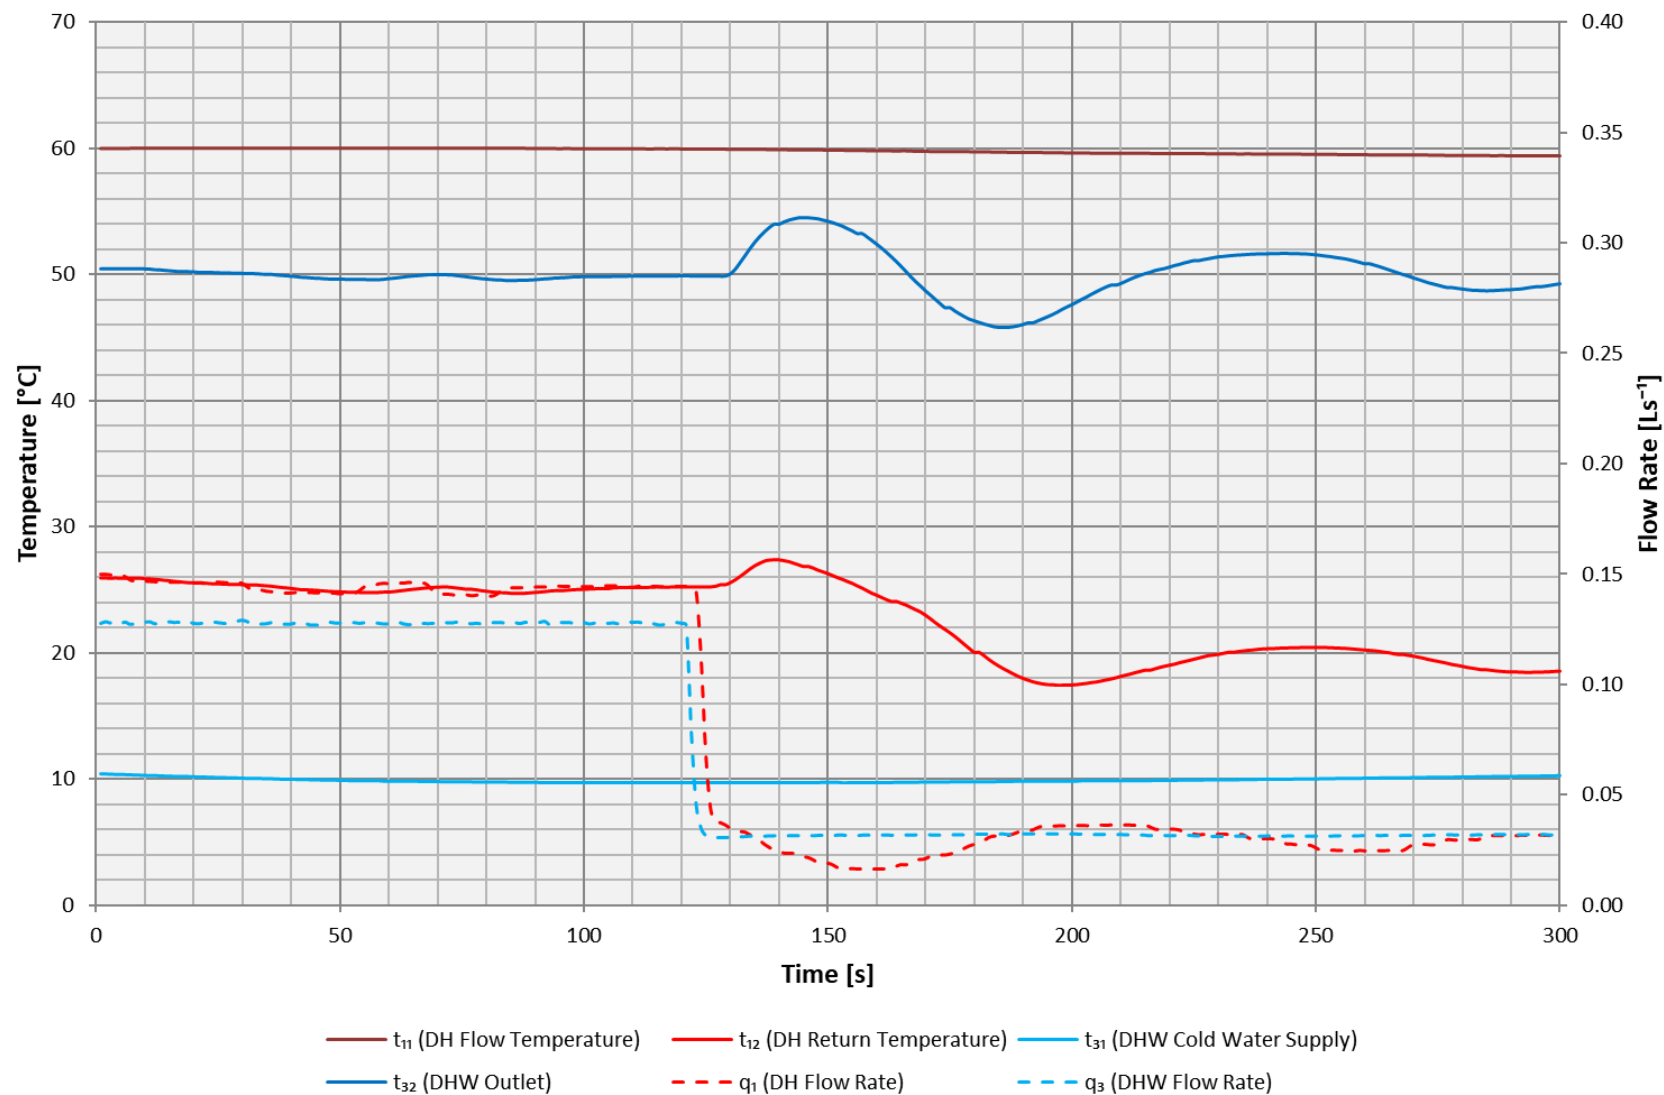


Figure 7.12 - Test 3d – Manufacturers Declared Low Flow DHW at 60 °C

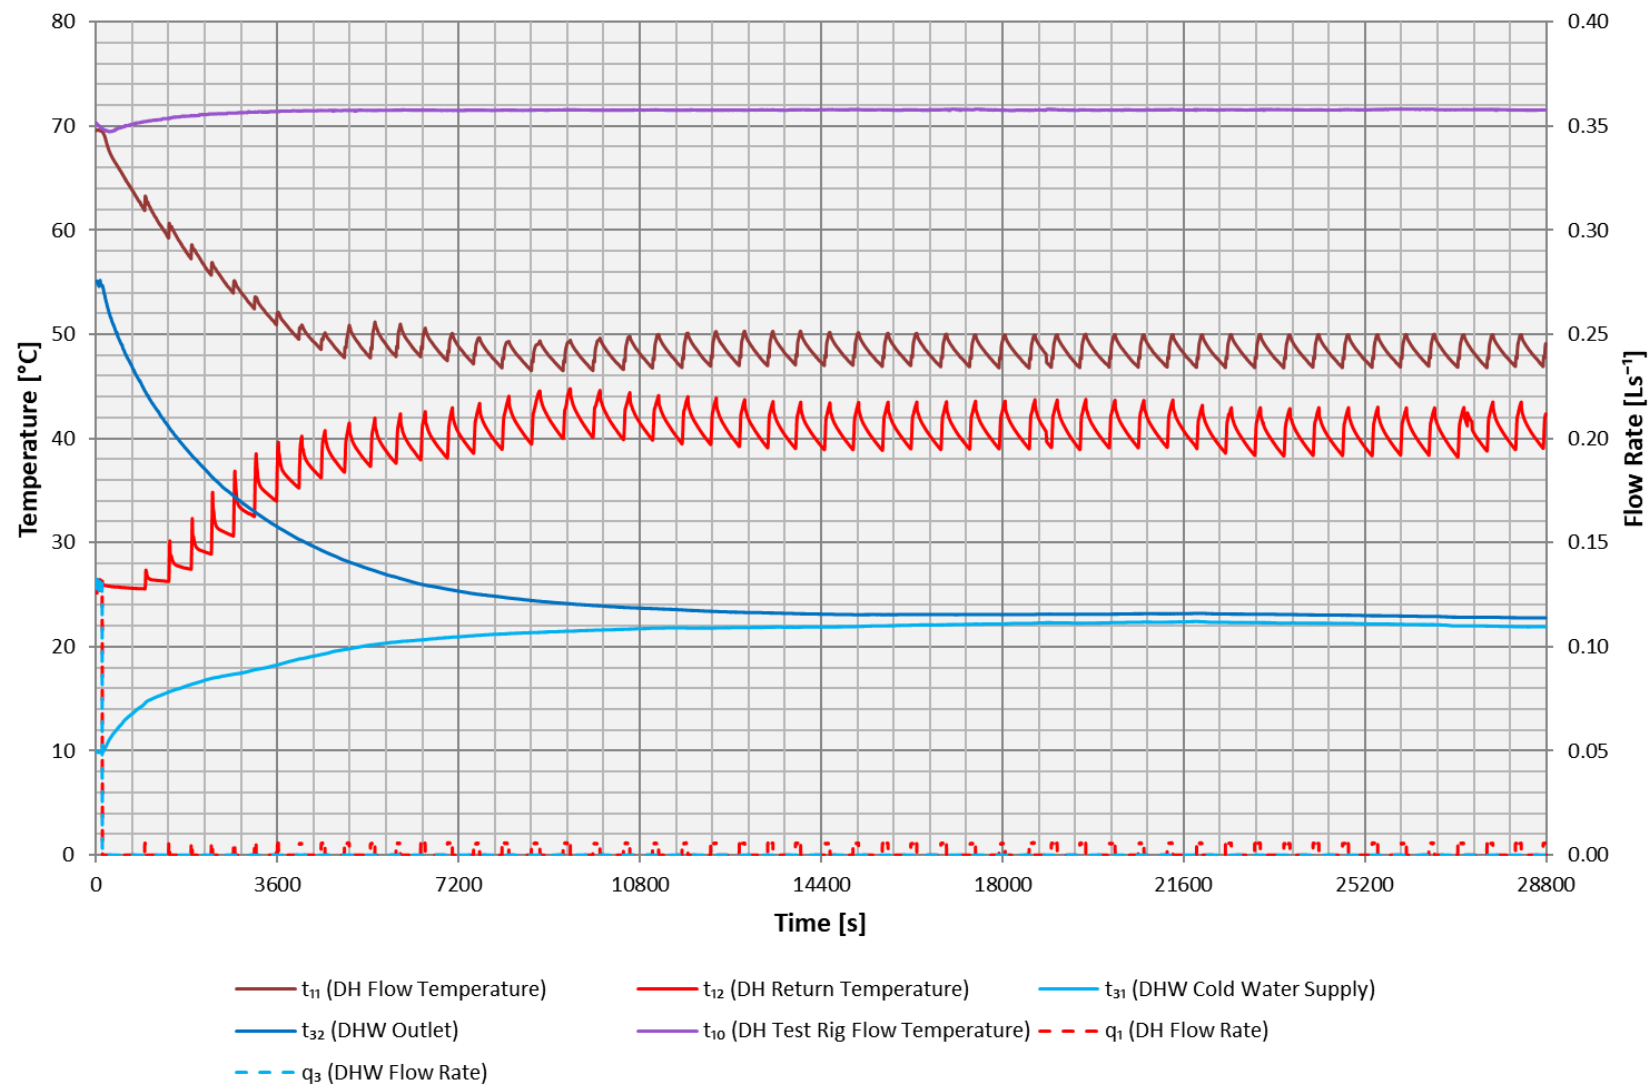


Figure 7.13 - Test 4a – Keep-Warm at 70 °C

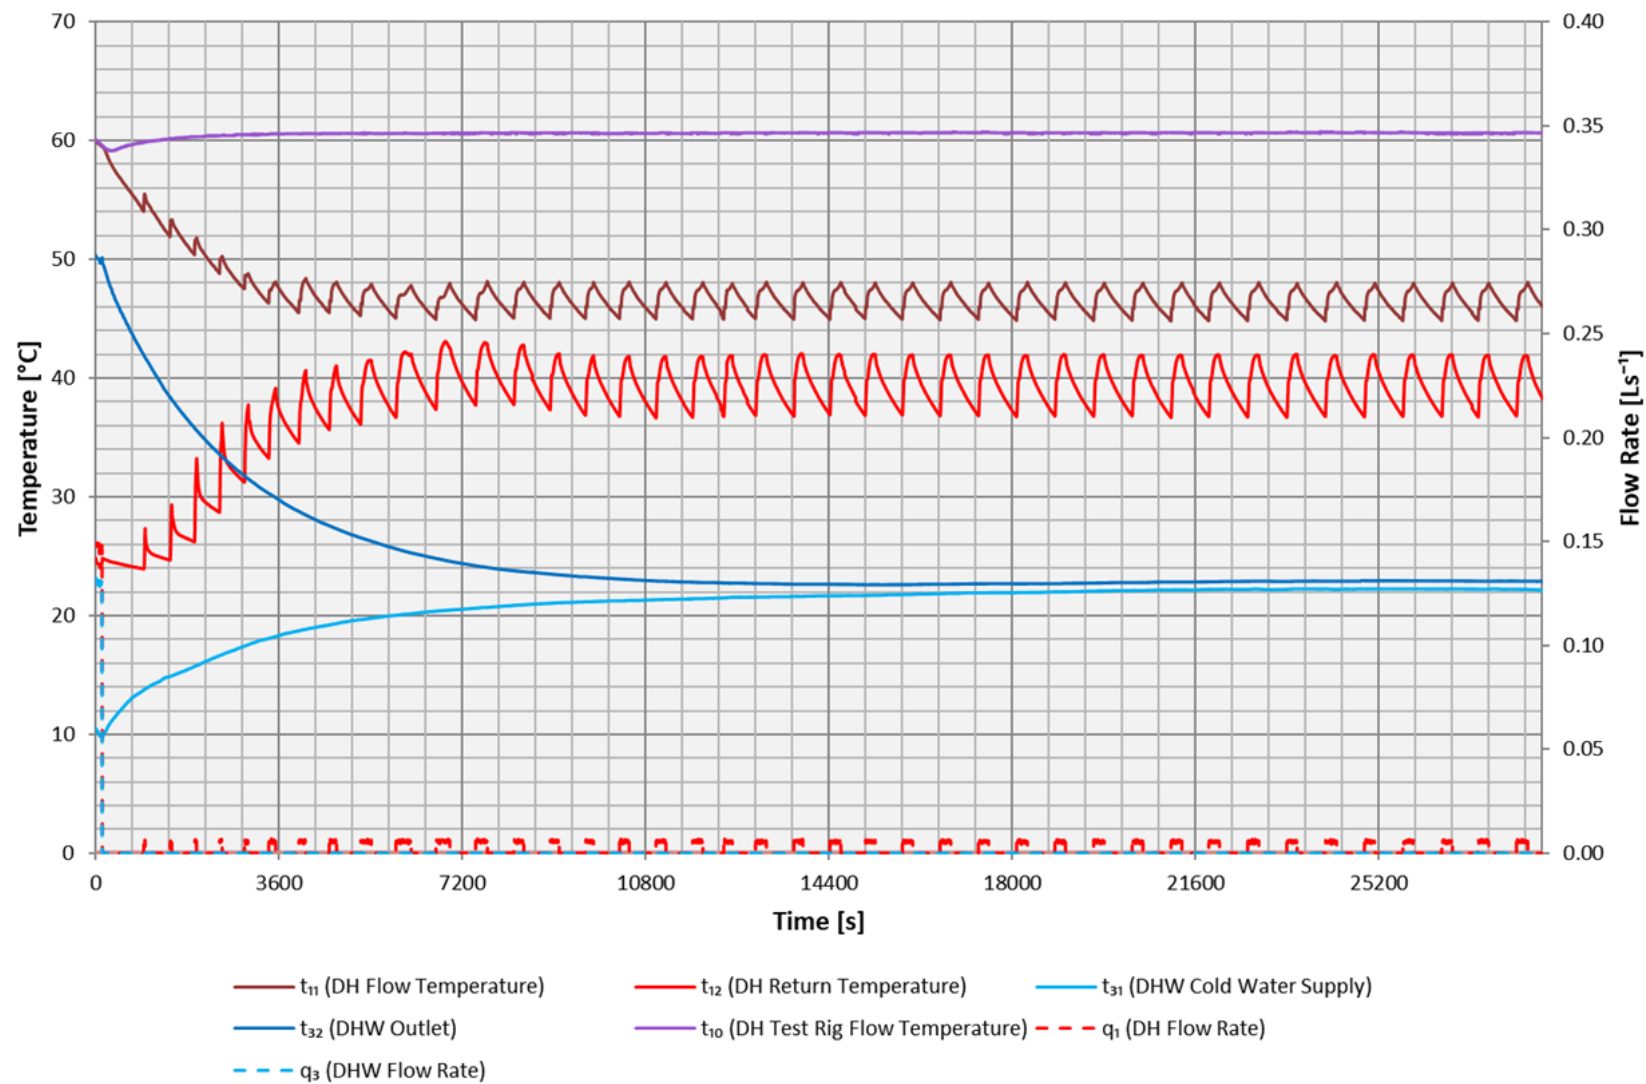


Figure 7.14 - Test 4b – Keep-Warm at 60 °C

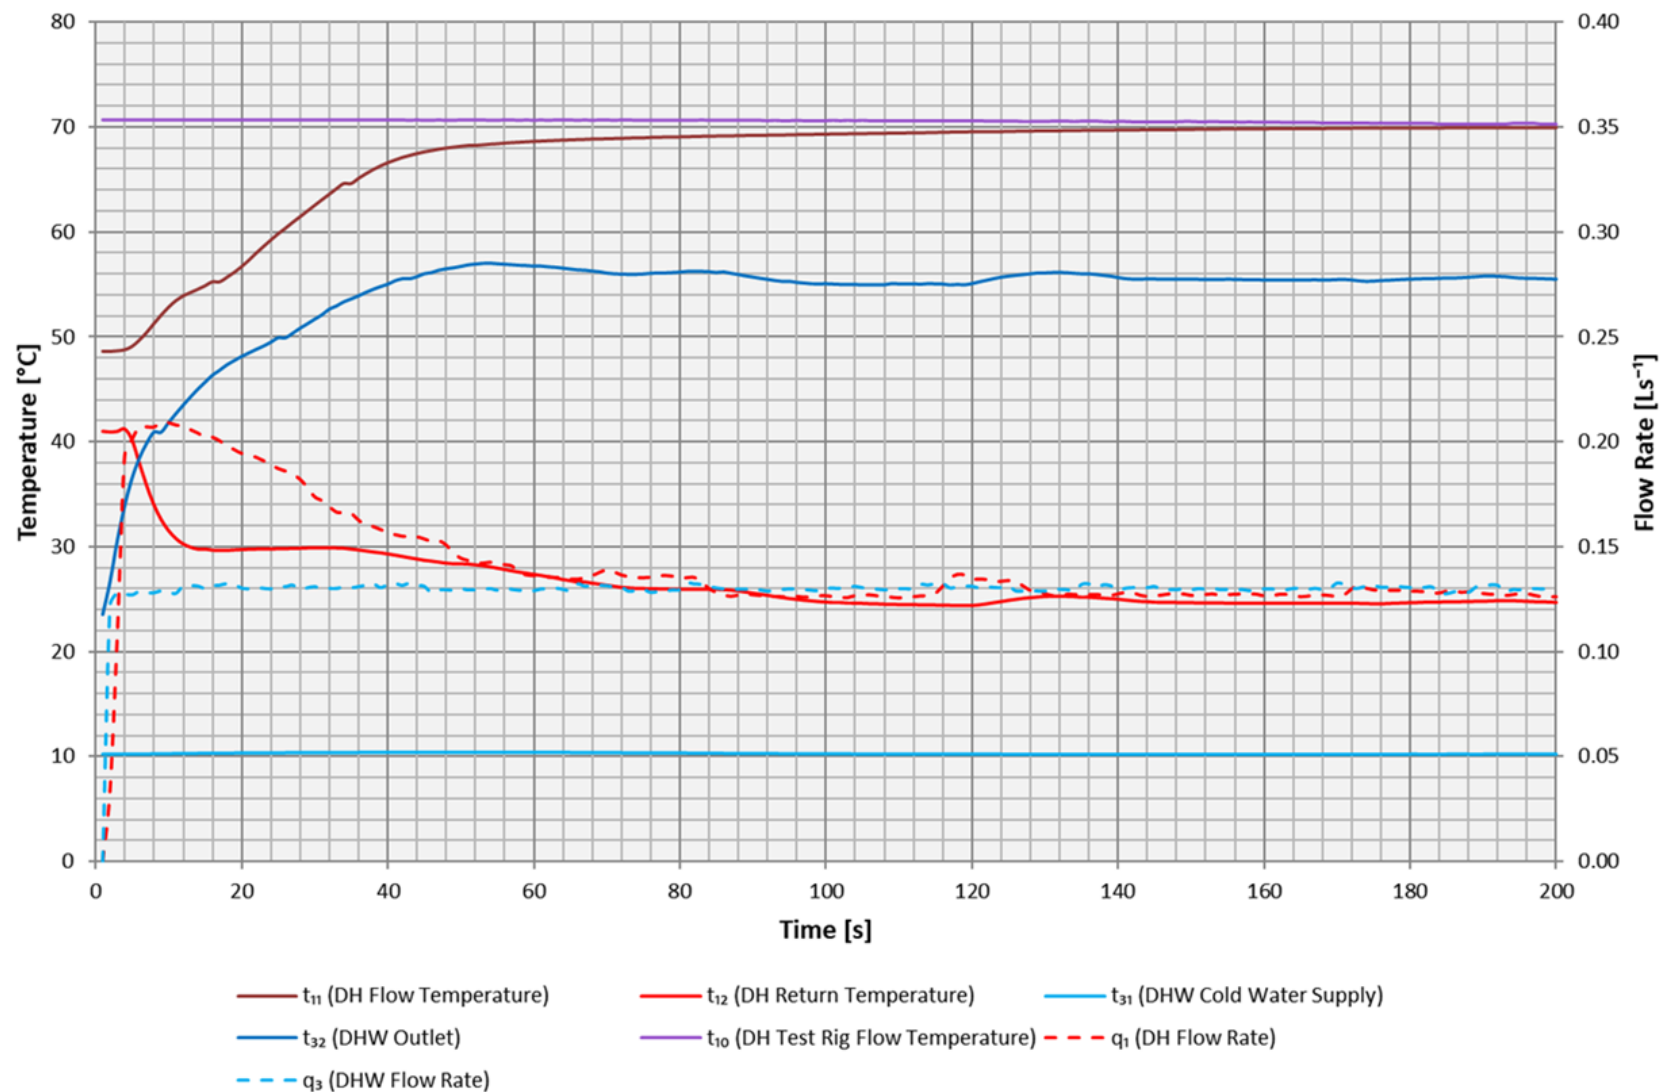


Figure 7.15 - Test 5a – DHW Response Time at 70 °C

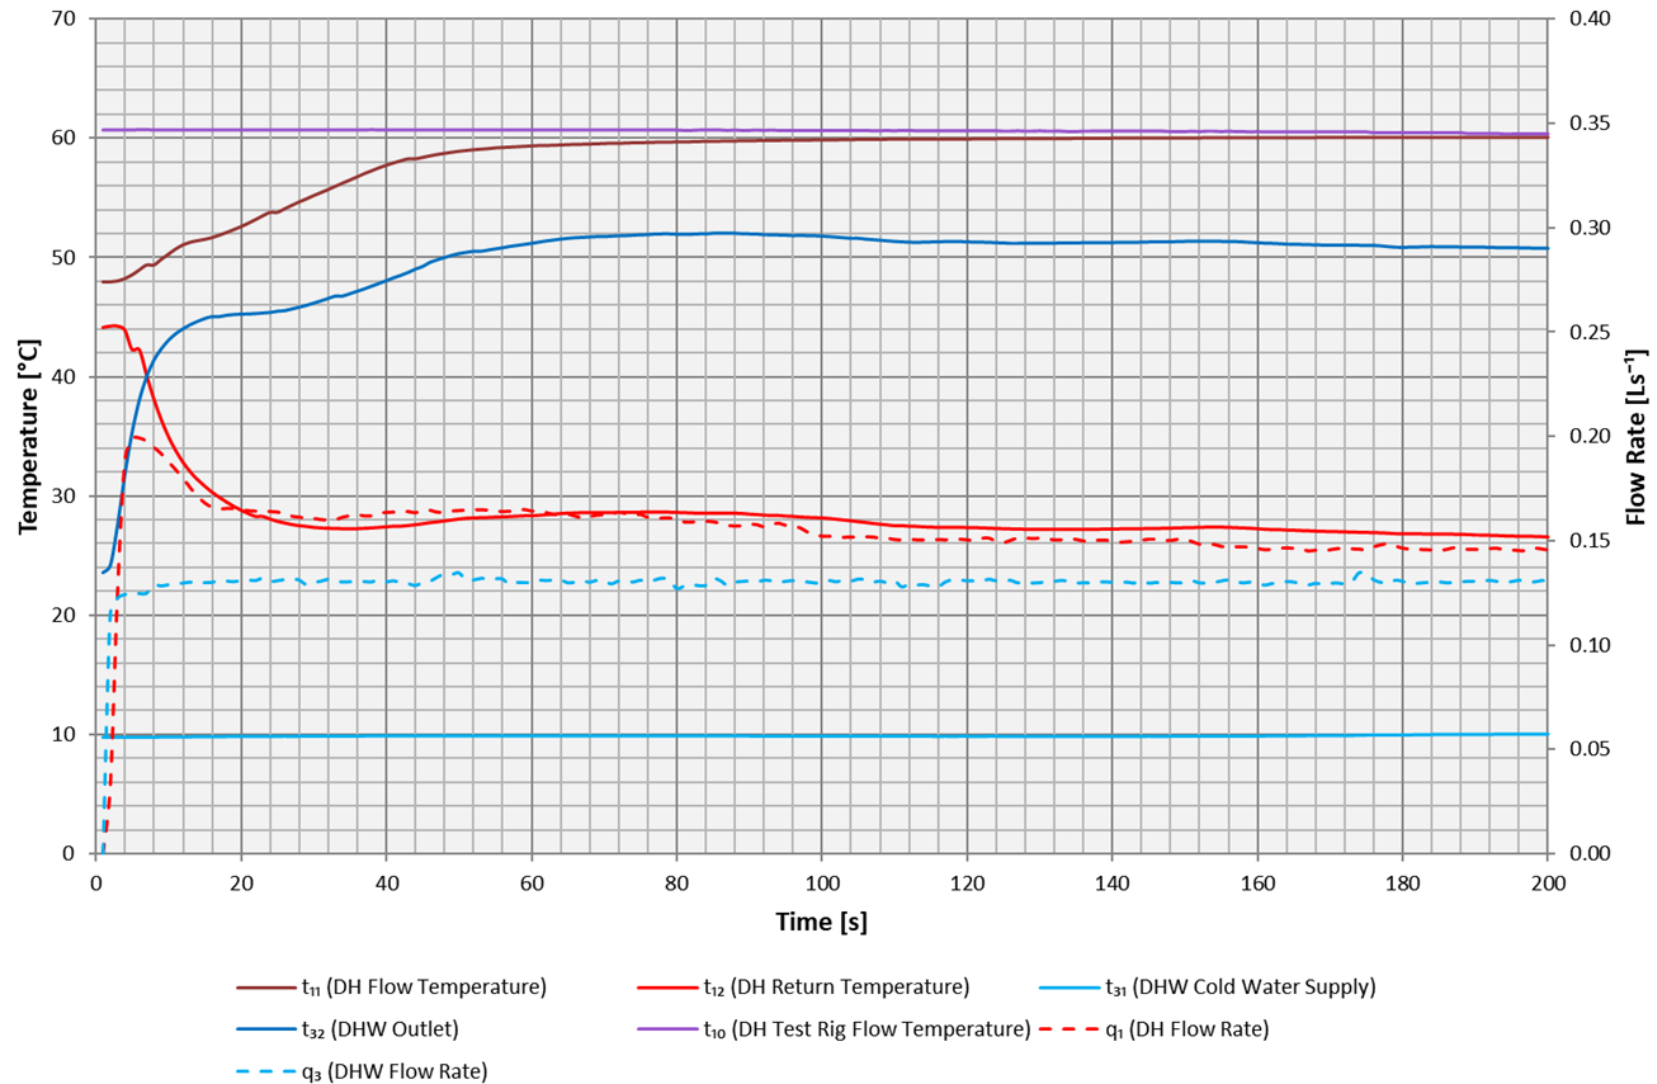


Figure 7.16 - Test 5b – DHW Response Time at 60 °C

7.2 Key Metric and VWARD Summary

- 7.2.1 The summary tables of the key metrics and VWARDS of the tests described in this report are given in this section.

SUMMARY TABLES START ON NEXT PAGE



VWART Calculation with Keep Warm

Test carried out by Enertek International for High Temperature BESA Tests

Manufacturer: BOSCH WORCESTER

Model: Greenstar HIU E

Serial number: 5570-273-000011-7735600660

Calculation performed by S.Broxham of Enertek on: 27/09/2021

Primary Flow Temperature: 70°C

DHW Setpoint: 55°C

Space Heating Temperature: 60/40°C

	VWART (°C)	Volume (m3)
DHW	23	27.1
Standby	42	29.7
Space Heating	44	51.4

	VWART with keep warm active	
Period	VWART (°C)	% Time
No Heating	33	93%
Heating	43	7%
Overall	33	

Test Results									
		Primary Power P1 [W]	Primary flow [m³/hr]	VWART [°C]	Energy Used [kWh]	Annual Operation [Hours]	Volume [m³]	Events [Per Year]	Average duration [Seconds]
1kW Space Heating	1a	1127	0.040	43	106	93.7	3.78	-	-
2kW Space Heating	1b	2154	0.073	44	798	370.8	27.15	-	-
4kW Space Heating	1c	4051	0.148	45	559	138.1	20.44	-	-
DHW Low Flow Rate	2a	10536	0.186	21	712	69.2	12.90	-	-
DHW Medium Flow Rate	2a	17661	0.335	23	302	16.8166	5.64	-	-
DHW High Flow Rate	2a	23126	0.447	24	451	19.2	8.57	-	-
DHW Post Low Flow Rate	2a	-	0.000	0	-	-	0.00	10000	30
DHW Post Medium Flow Rate	2a	-	0.000	0	-	-	0.00	660	70
DHW Post High Flow Rate	2a	-	0.000	0	-	-	0.00	300	145
DHW Keep Warm Standby	4a	-	0.004	42	266	8052.3	29.66	-	-

Table 7.1 - Key Metrics of High Temperature Package



VWART Calculation with Keep Warm

Test carried out by Enertek International for Low Temperature BESA Tests

Manufacturer: BOSCH WORCESTER

Model: Greenstar HIU E

Serial number: 5570-273-000011-7735600660

Calculation performed by S.Broxham of Enertek on: 27/09/2021

Primary Flow Temperature: 60°C
 DHW Setpoint: 50°C
 Space Heating Temperature: 45/35°C

	VWART (°C)	Volume (m3)
DHW	24	34.7
Standby	40	42.4
Space Heating	38	54.6

	VWART with keep warm active	
Period	VWART (°C)	% Time
No Heating	33	94%
Heating	38	6%
Overall	34	

Test Results									
		Primary Power P1 [W]	Primary flow [m³/hr]	VWART [°C]	Energy Used [kWh]	Annual Operation [Hours]	Volume [m³]	Events [Per Year]	Average duration [Seconds]
1kW Space Heating	1d	1029	0.042	38	93	90.8	3.78	-	-
2kW Space Heating	1e	2208	0.086	38	752	340.8	29.42	-	-
4kW Space Heating	1f	4065	0.169	39	515	126.6	21.35	-	-
DHW Low Flow Rate	2b	9843	0.220	23	685	74.1	16.32	-	-
DHW Medium Flow Rate	2b	16155	0.396	25	292	18.4	7.27	-	-
DHW High Flow Rate	2b	21064	0.529	26	432	21.1	11.15	-	-
DHW Post Low Flow Rate	2b	-	0.000	0	-	-	0.00	10000	30
DHW Post Medium Flow Rate	2b	-	0.000	0	-	-	0.00	660	70
DHW Post High Flow Rate	2b	-	0.000	0	-	-	0.00	300	145
DHW Keep Warm Standby	4b	-	0.005	40	234	8088.2	42.37	-	-

Table 7.2 - Key Metrics of Low Temperature Package

8 APPENDIX B

8.1 Appliance Documentation

8.1.1 The details of the appliance documentation are given in Table 8.1 below.

Table 8.1 – Documentation Supplied

	Component:	Document Submitted (Y/N):	Manufacturer and Type:
1	Space Heating Heat Exchanger	Y	SWEP, Copper brazed
2	Domestic Hot Water Heat Exchanger	Y	SWEP, Copper brazed
3	Controller for Space Heating	Y	Braga, Control board
4	Control Valve and Actuator for Space Heating	Y	ESBE Actuator
5	Space Heating Strainer	Y	N/A
6	Controller for Domestic Hot Water	Y	Braga, Control board
7	Control Valve and Actuator for Domestic Hot Water	Y	ESBE Actuator
8	Temperature Sensors	Y	Exa-thermometrics
9	Domestic Hot Water Isolating Valve	Y	Altecnic
10	Primary Side Strainer	Y	Italfim SPA
11	Drain Valves	Y	Orkli
12	Vent Valves	Y	Novasfer
13	Circulation Pump set with AAV & PRV	Y	Grundfos
14	Heat Meter	Y	Sontex 749 Mbus
15	Domestic Hot Water Flow Sensor	Y	Saginomiya
16	Pipes	Y	Bosch, Stainless steel
17	Connections	Y	Altecnic
18	Joints	Y	Altecnic
19	Gaskets	Y	Altecnic
20	Expansion Vessel	Y	Zilmet
21	Insulation	Y	Synprodo
22	Pressure Sensors	Y	Wika pressure gauge
A1	'O' Ring	Y	Altecnic
A2	Commissioning Guide.	Y	Installation manual
A3	Operation Guides with a Function Description / Description of Operation and Care Instructions as Suited to the Intended User Category.	Y	Owner's manual
A4	Declaration of Conformity for CE-Marked HIUs.	Y	
A5	Full Parameter List for Electrically Controlled HIUs.	Y	Installation manual
A6	Maximum Primary Static Operating Differential Pressure.	Y	Installation manual
A7	Deactivation Procedure of the Internal SH Pump.	Y	Installation manual
	Model Name and Type Number	Y	Greenstar HIU E with heat meter.
	Software Version / Date of Issue	Y	NF51.05; Power 230V / 50Hz - January 2022
	Serial Number	Y	5570-273-000010-7735600660


8.2 Appliance Photographs



Figure 8.1 – Photograph of Appliance [Case Fitted]



Figure 8.2 – Photograph of Appliance [Case Removed]



Greenstar HIU E with heat meter
Serial Number 5570-273-000011-7735600660

Electrical supply ~ 230V/50Hz/IPH
Maximum electrical power 42 W
Ingress protection IPX4D

Maximum operating pressure (static)
Primary Circuit 10 bar

Maximum operating pressure (static)
Secondary Circuit CH 2.5 bar

Maximum operating pressure secondary
DHW circuit 10 bar

Maximum differential pressure (dynamic)
Primary circuit 4 bar

Controlled differential pressure 0.3 bar

Maximum operating temperature
Primary circuit 90 Deg C

Central heating output (min/max) 1/15 kW

Maximum DHW output at 35K rise 36.6 kW

Maximum DHW flow rate 15 l/min



Bosch Thermotechnology Ltd.
Worcester WR4 9SW / United Kingdom

Figure 8.3 – Appliance Data Label

8.3 Calibrations and Uncertainties

8.3.1 A list of equipment, their calibrations and uncertainties are given in table 8.8 below.

Table 8.2 - EIL Equipment Calibration and Uncertainties

Equipment Name	ID Number	Calibration Certificate	Measurement Uncertainty $K=2$ $\frac{U}{\sqrt{20}}$	Units	Calibration Date	Calibration Due
Flow Meter [Primary Flow Rate]	FM 601	K48376FW1S2	±0.0004	l/s	07/07/2021	07/2022
Flow Meter [DHW Flow Rate]	FM 602	K48378FW	±0.00305	l/s	07/07/2021	07/2022
Flow Meter [SH Flow Rate]	FM 603	K48377FW	±0.04871	l/s	06/07/2021	07/2022
Flow Meter [DHW Flow Rate]	FM 605	K48375FW	±0.00576	l/s	05/07/2021	07/2022
Pressure Transducer [Primary Supply]	PT 086	K48379P	±6.91	kPa	05/07/2021	07/2022
Pressure Transducer [Primary Return]	PT 085	K48384P	±8.54	kPa	05/07/2021	07/2022
Pressure Transducer [DHW Output Pressure]	PT 083	K48380P	±21.27	kPa	05/07/2021	07/2022
Pressure Transducer [DHW Cold Water Supply]	PT 084	K48383P2	±9.21	kPa	20/07/2021	07/2022
Pressure Transducer [SH Flow]	PT 087	K48382P	±7.10	kPa	05/07/2021	07/2022
Pressure Transducer [SH Return]	PT 088	K48381P	±15.24	kPa	05/07/2021	07/2022
PRT Probe [Primary Supply Temp]	PRT 4709	443851	±0.6	°C	10/07/2021	07/2022
PRT Probe [Primary Return Temp]	PRT 4708	443851	±0.6	°C	10/07/2021	07/2022
PRT Probe [DHW Output Temp]	PRT 4711	443852	±0.6	°C	10/07/2021	07/2022
PRT Probe [Cold Water Supply Temp]	PRT 4710	443852	±1.91	°C	10/07/2021	07/2022
PRT Probe [SH Supply Temp]	PRT 4707	443851	±0.57	°C	10/07/2021	07/2022
PRT Probe [SH Return Temp]	PRT 4706	443851	±1.06	°C	10/07/2021	07/2022

Equipment Name	ID Number	Calibration Certificate	Measurement Uncertainty $K=2 \frac{U}{\sqrt{20}}$	Units	Calibration Date	Calibration Due
Pressure Transducer [Static Pressure Test]	PT 090	U100553-19	±50	kPa	21/11/2019	11/2021
Power Meter [Electrical Consumption]	PM1022	U103585-20	±1.03	W	28/07/2021	09/2021
Software	VERSION – LabVIEW, Version 5, Service pack 1					

Report Issue No	Reason for Report Update
1	Original Issue 31/01/2022
2	Photo of internal HIU updated. 02/03/2022

THIS PAGE IS INTENTIONALLY LEFT BLANK



1 Malmo Road
Sutton Fields
Kingston upon Hull, HU7 0YF

+44 (0) 1482 877500
enertekinternational.com
Registered in England No. 2262638

